

TEST DATA OF FSB-10-□□□-U

Noise Filter

April. 28. 2016

Approved by : Tadayuki Noda
Tadayuki Noda Design Manager

Prepared by : Kenji Kamoi
Kenji Kamoi Design Engineer

COSEL CO.,LTD.



CONTENTS



1. Attenuation Characteristics	1
2. Leakage Current	3
3. Figure of Testing Circuitry	4

(Final Page 5)




Model	FSB-10-□□□-U
Item	Attenuation Characteristics
Object	_____

Temperature 25°C
Testing Circuitry Figure A

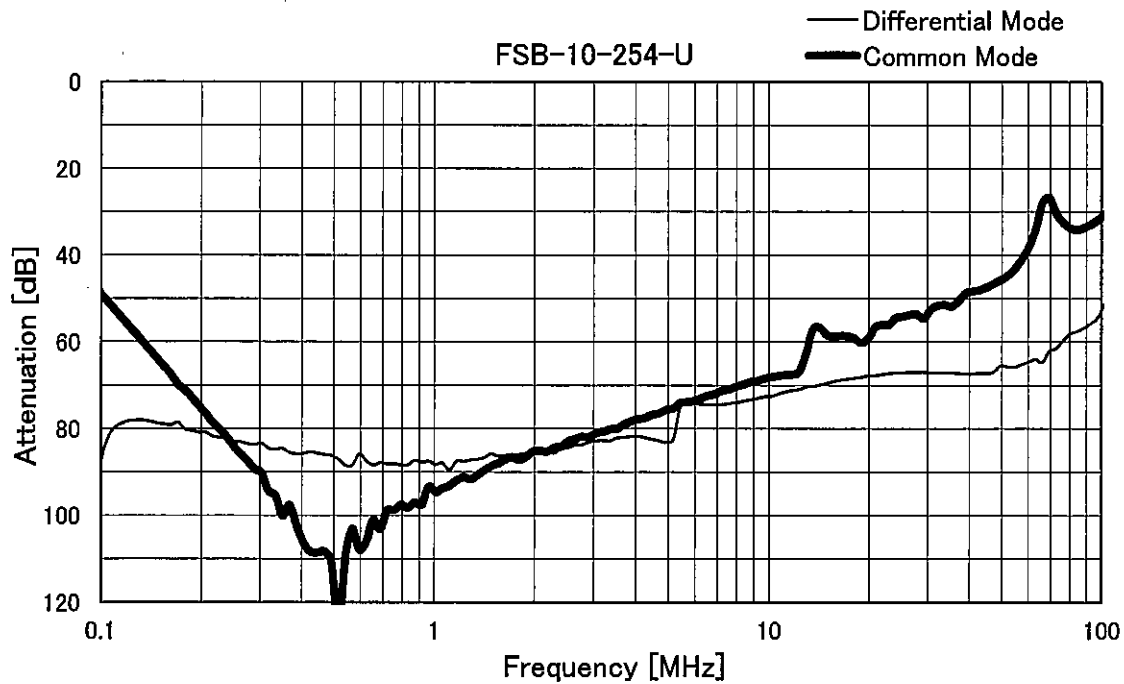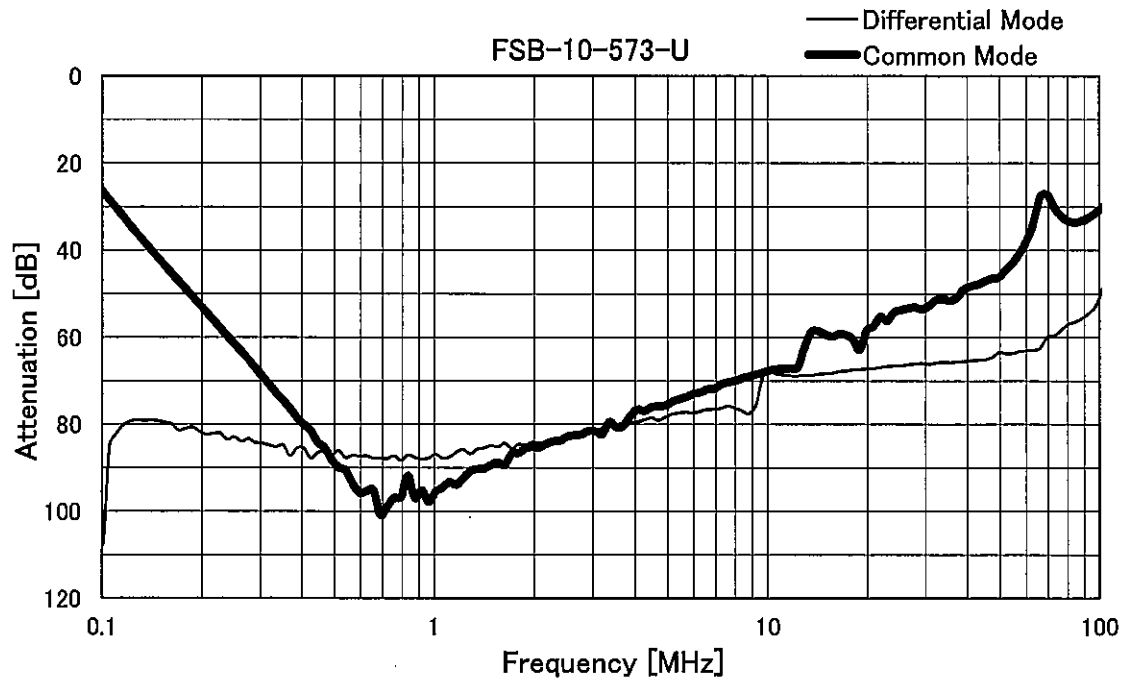

COSEL

Model	FSB-10-000-U	Temperature 25°C Testing Circuitry Figure A
Item	Attenuation Characteristics	
Object	_____	

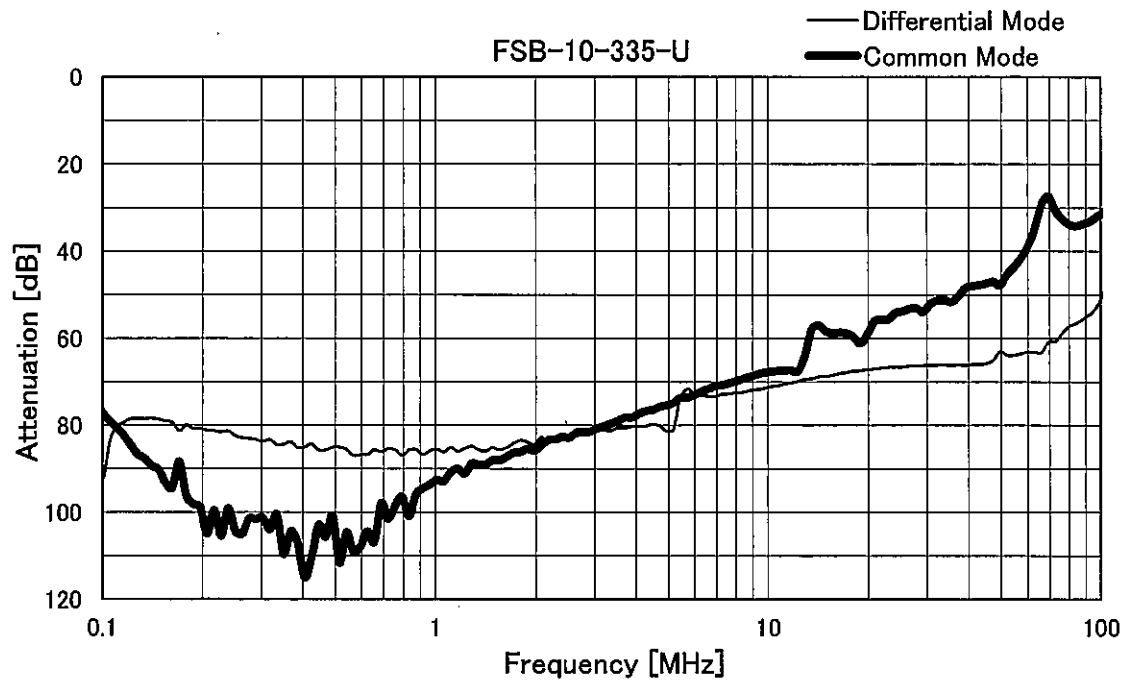



Model		FSB-10-□□□-U	Temperature 25°C Testing Circuitry Figure B
Item		Leakage Current	
Object		_____	

1.Results

[mA]

Model	Standards	Voltage system	Input Volt.					Note
			200[V]	250[V]	400[V]	480[V]	500[V]	
FSB-10-573-U	UL1283	Δ-connection	1.70	2.10				
		Wye-connection	0.01	0.01				
FSB-10-254-U	UL1283	Δ-connection	6.00	8.00				
		Wye-connection	0.03	0.03				
FSB-10-335-U	UL1283	Δ-connection	60	75				
		Wye-connection	0.48	0.59				

2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

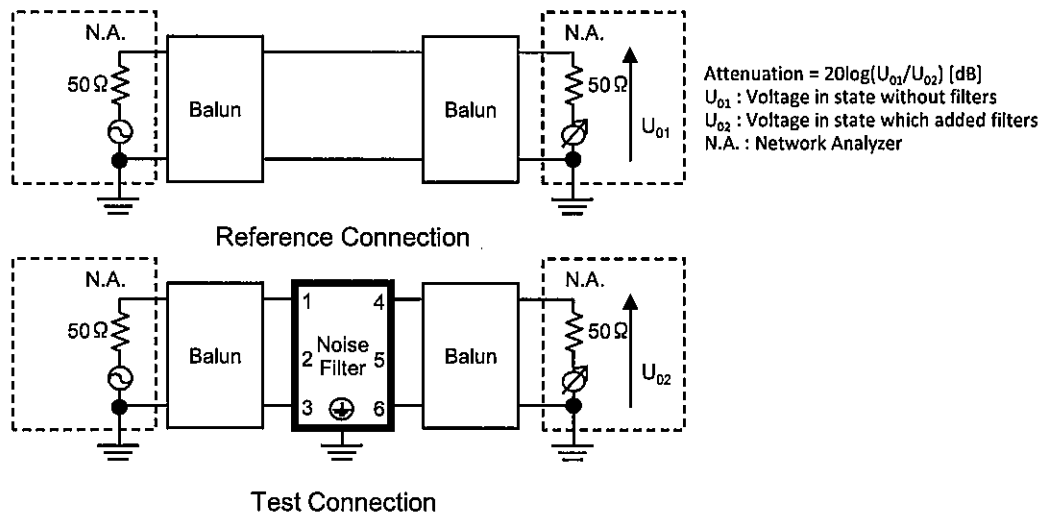


Figure A - 1 Differential mode attenuation measurement

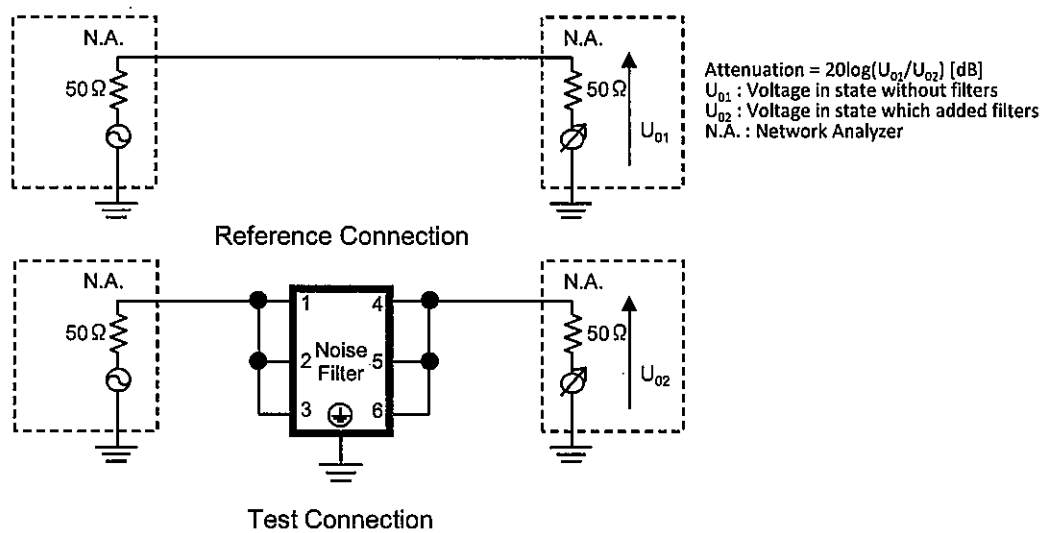


Figure A - 2 Common mode attenuation measurement

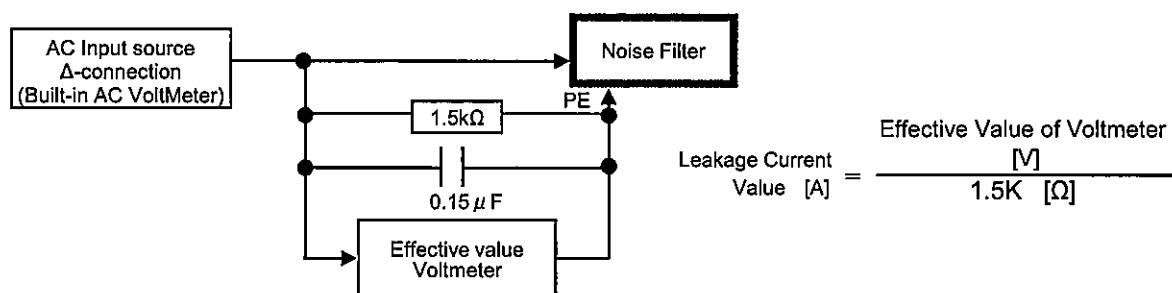


Figure B-1 Leakage current measurement (UL1283 Δ-connection)

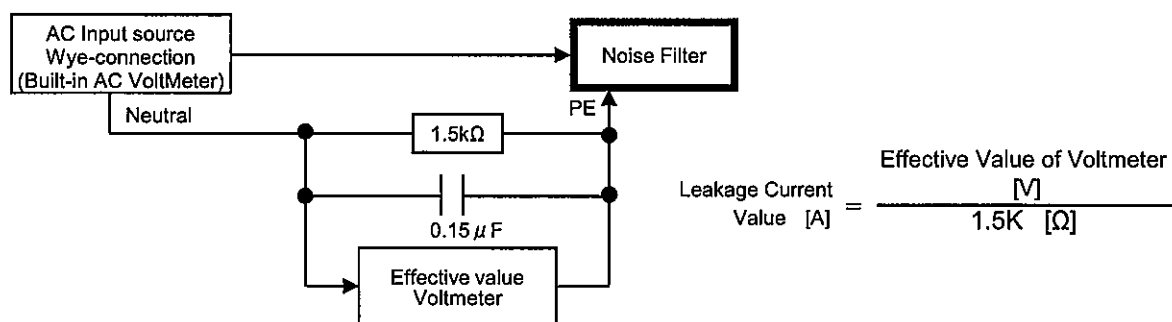


Figure B-2 Leakage current measurement (UL1283 Wye-connection)