

TEST DATA OF FTA-150-335

Noise Filter

October. 9. 2014

Approved by : Kazunari Asano
Kazunari Asano Design Manager

Prepared by : Takeshi Kato
Takeshi Kato Design Engineer

COSEL CO.,LTD.


CONTENTS

1. Attenuation Characteristics	1
2. Leakage Current	2
3. Figure of Testing Circuitry	3
(Final Page 3)	

COSEL

Model	FTA-150-335
Item	Attenuation Characteristics
Object	

Temperature 25°C
Testing Circuitry Figure A

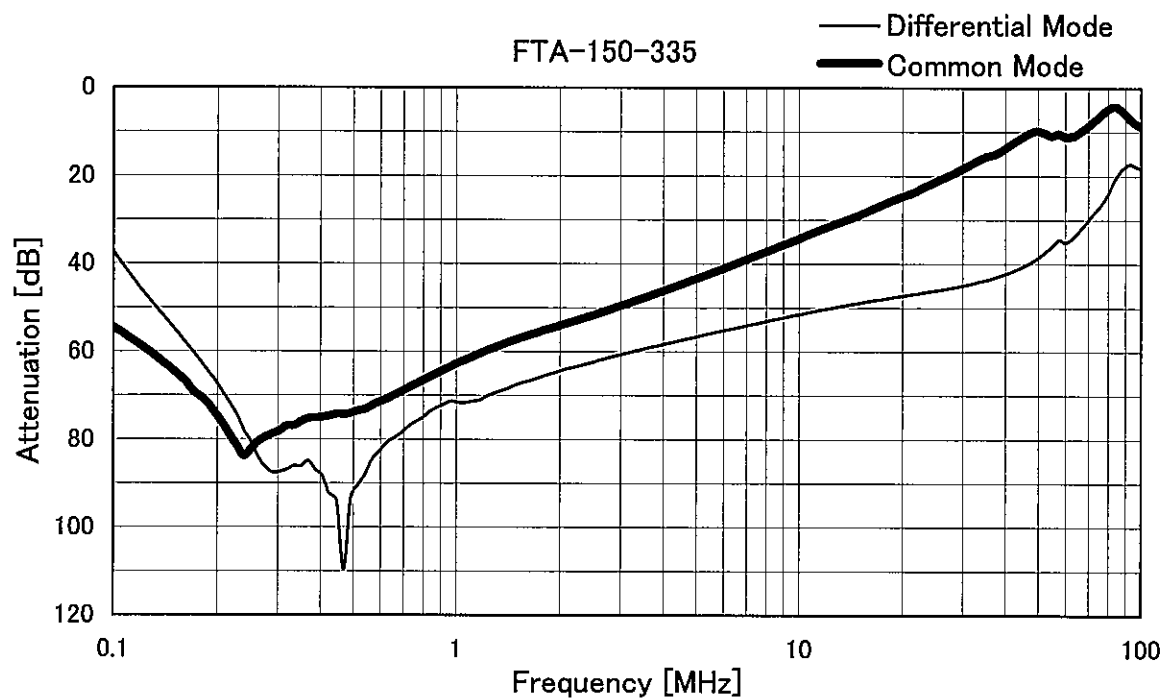

COSEL

		Temperature 25°C Testing Circuitry Figure B
Model	FTA-150-335	
Item	Leakage Current	
Object		

1.Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
FTA-150-335	UL1283	72.0	90.0	144.0			Δ-connection's rated voltage is 400V(440Vmax)

2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

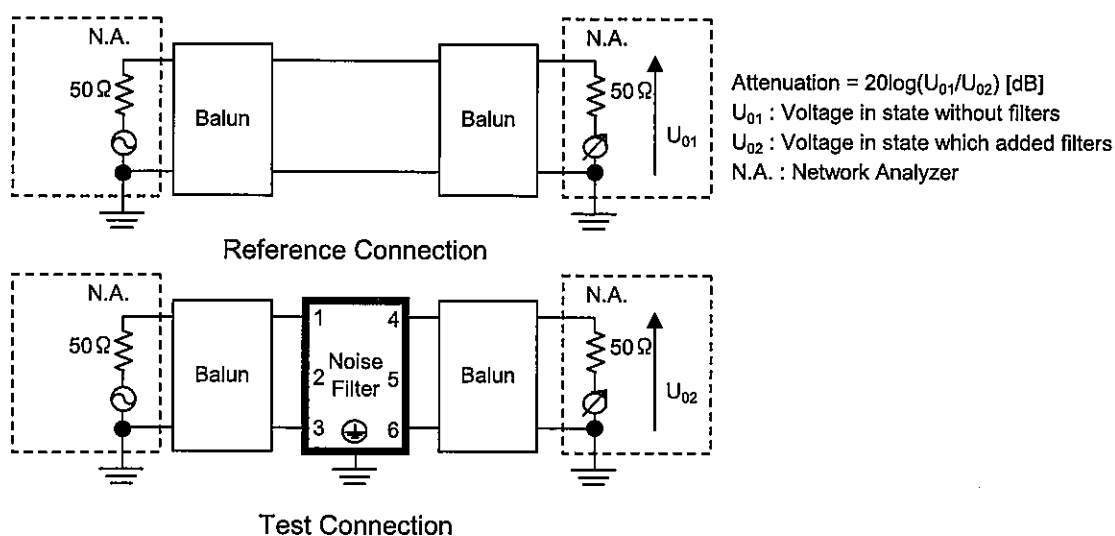


Figure A - 1 Differential mode attenuation measurement

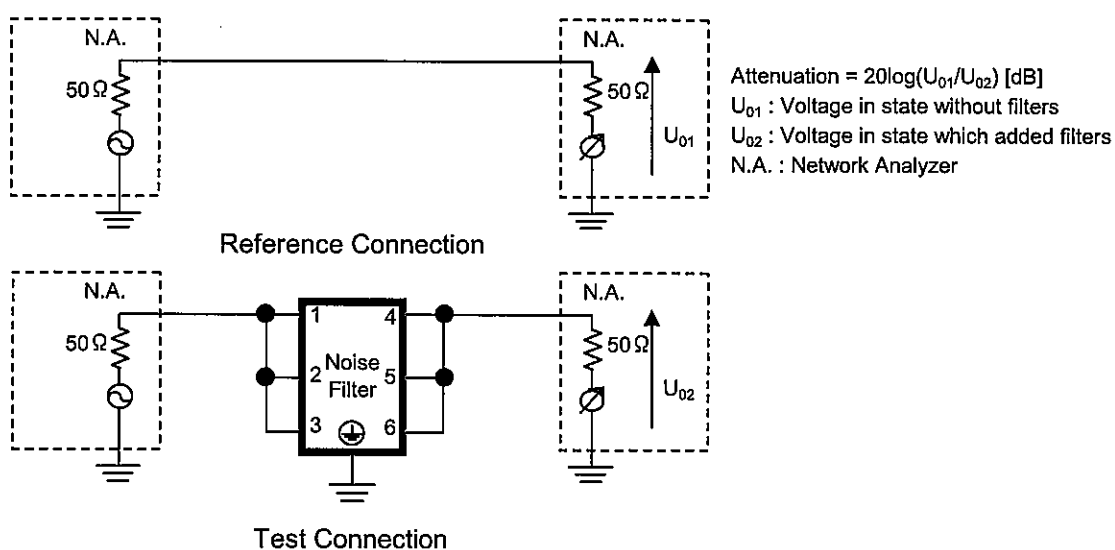


Figure A - 2 Common mode attenuation measurement

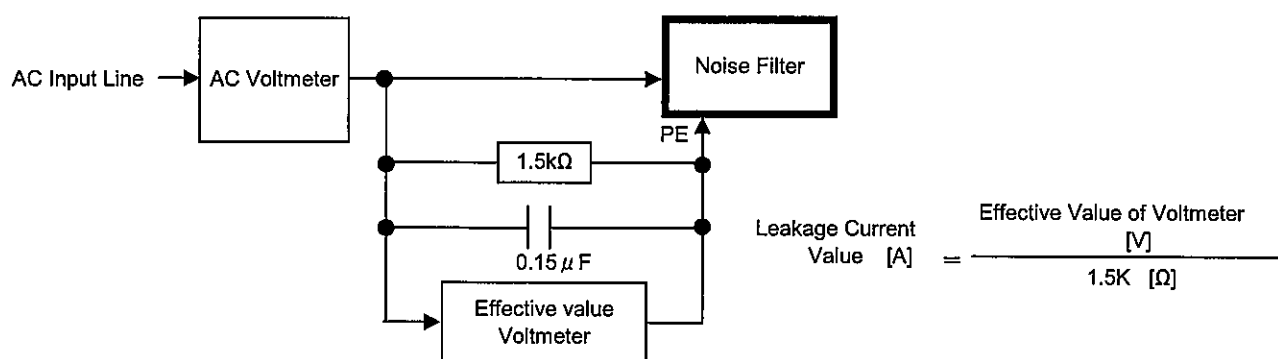


Figure B Leakage current measurement (UL1283)