

TEST DATA OF FTA-60-□□□

Noise Filter

December. 21. 2012

Approved by : Yuichi Uozu
Yuichi Uozu Design Manager

Prepared by : Tadayuki Noda
Tadayuki Noda Design Engineer



COSEL CO.,LTD.

CONTENTS

1.Attenuation Characteristics	1
2.Leakage Current	3
3.Figure of Testing Circuitry	4
(Final Page 4)	



COSEL

Model	FTA-60-□□□	Temperature 25°C Testing Circuitry Figure A
Item	Attenuation Characteristics	
Object	_____	

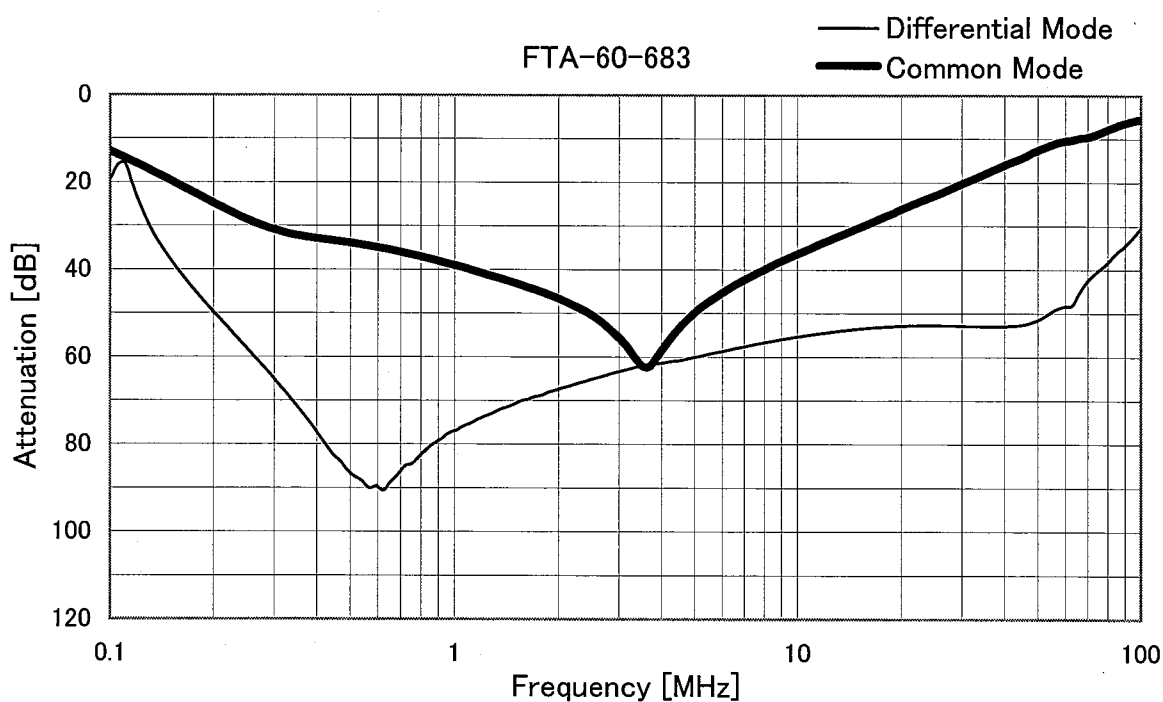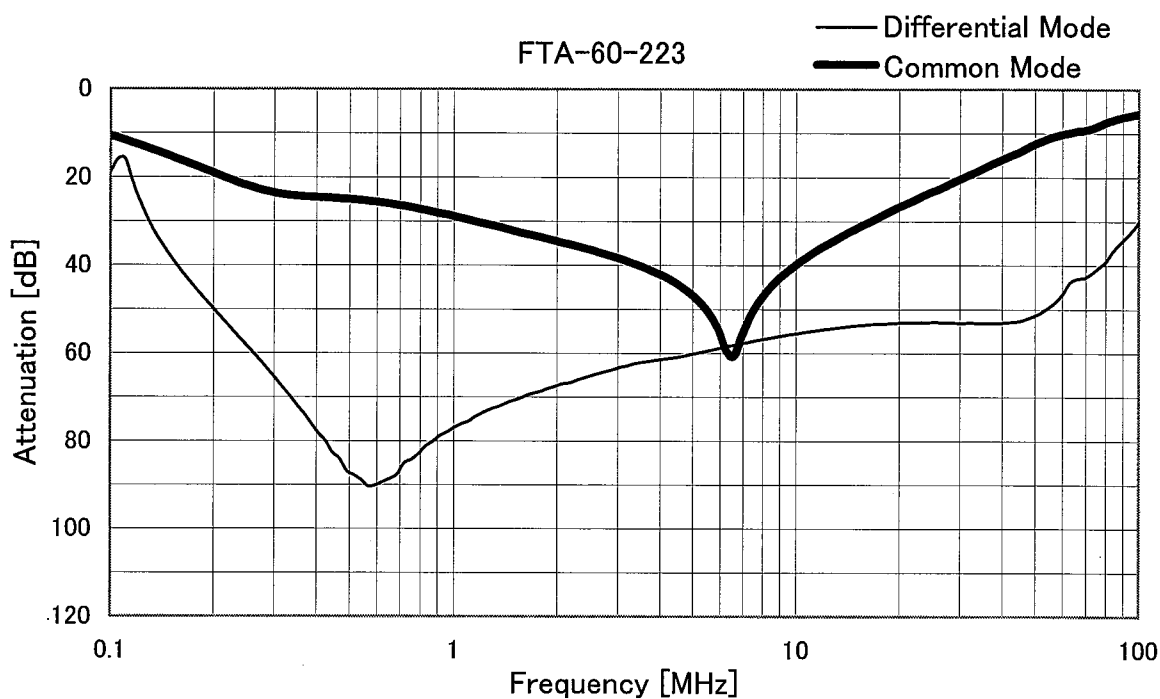

COSEL

Model	FTA-60-□□□	Temperature 25°C Testing Circuitry Figure A
Item	Attenuation Characteristics	
Object	_____	

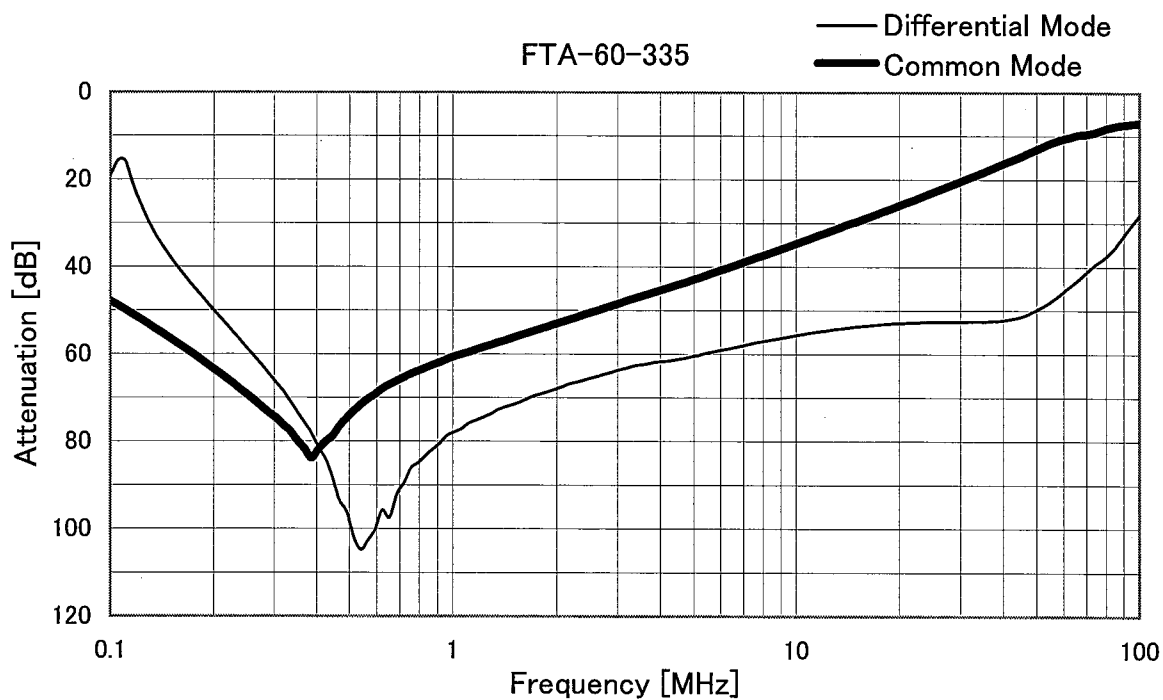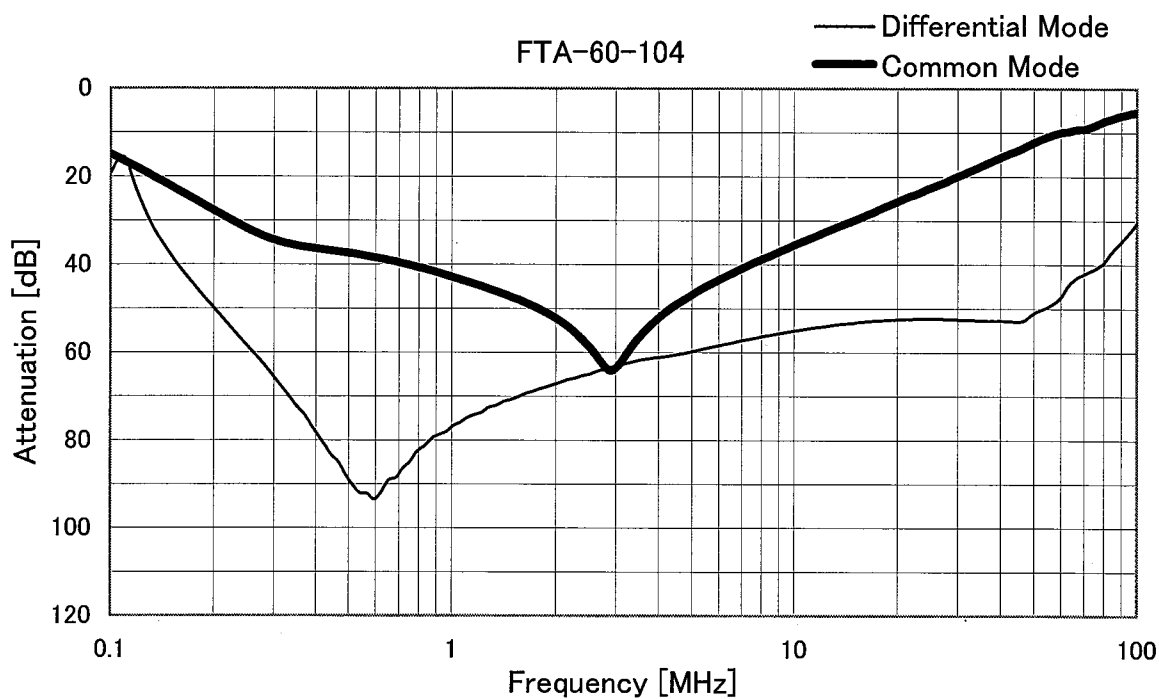

COSEL

		Temperature 25°C Testing Circuitry Figure B
Model	FTA-60-□□□	
Item	Leakage Current	
Object	_____	

1.Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
FTA-60-223	UL1283	0.45	0.57	0.92	1.1	1.1	
FTA-60-683	UL1283	1.4	1.8	2.9	3.4	3.5	
FTA-60-104	UL1283	2.1	2.7	4.1	5.0	5.2	
FTA-60-335	UL1283	58.0	72.5	116.0			Δ-connection's rated voltage is 400V(440Vmax)

2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

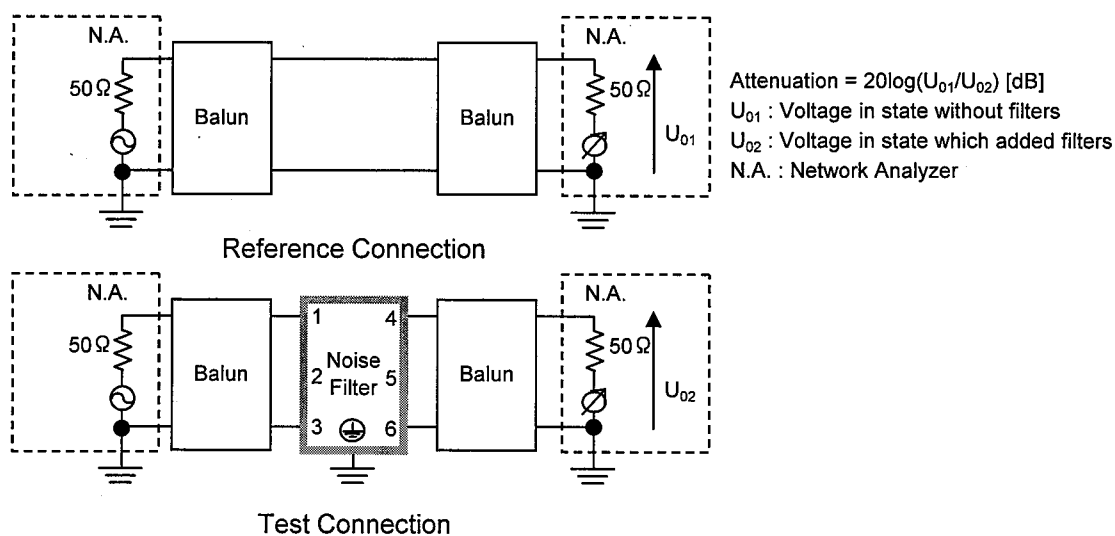


Figure A - 1 Differential mode attenuation measurement

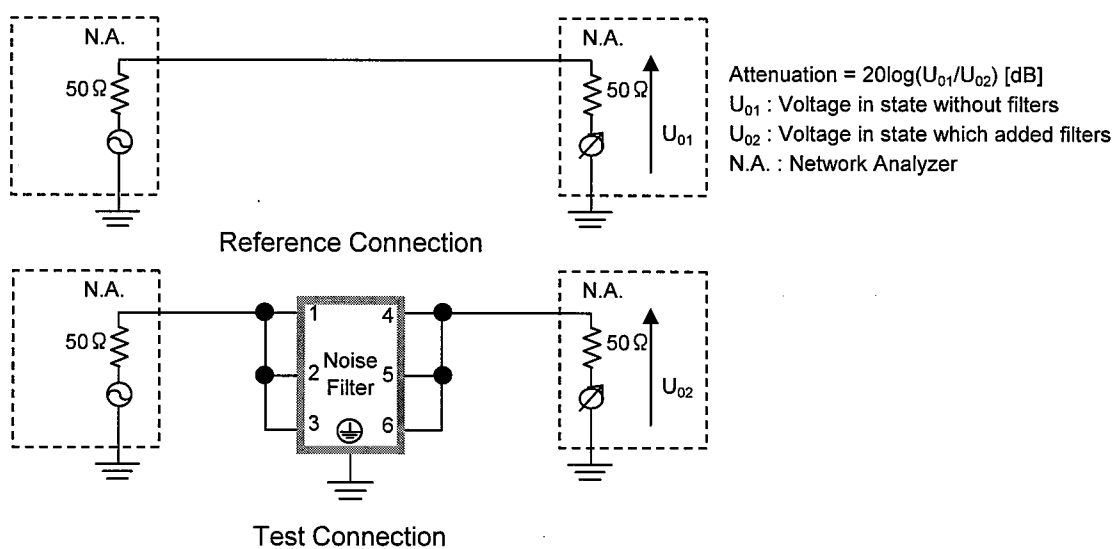


Figure A - 2 Common mode attenuation measurement

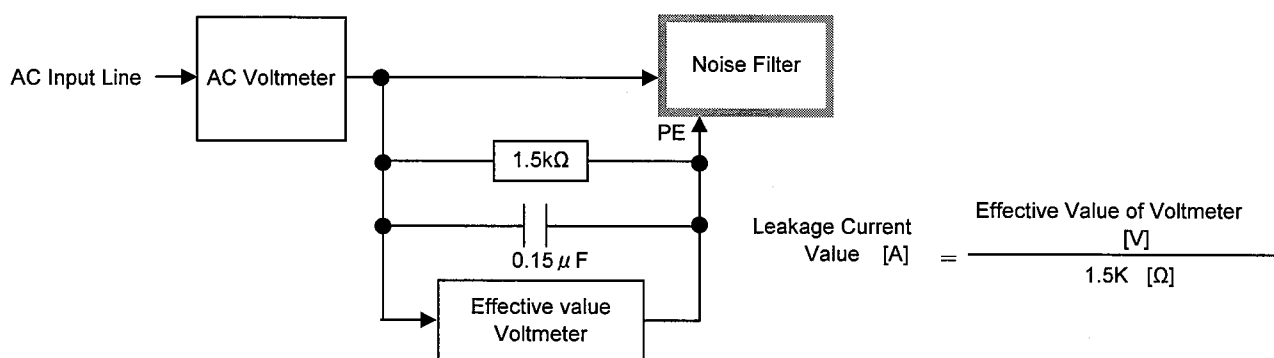


Figure B Leakage current measurement (UL1283)