



EXTRA TEST DATA OF LHA50F-36

*Regulated DC Power Supply
Feb 20, 2021*

COSEL CO.,LTD.



CONTENTS

1.Inrush Current (enlargement)	1
2.Dynamic Line Regulation	2
3.Overtoltage Protection (waveform)	3
4.Hiccup cycle (by Overcurrent Protection)	4
5.Figure of Testing Circuitry	5

(Final Page 5)




COSEL


Model	LHA50F-36		
Item	Inrush Current (enlargement)	Temperature	25°C
Object	_____	Testing Circuitry	A

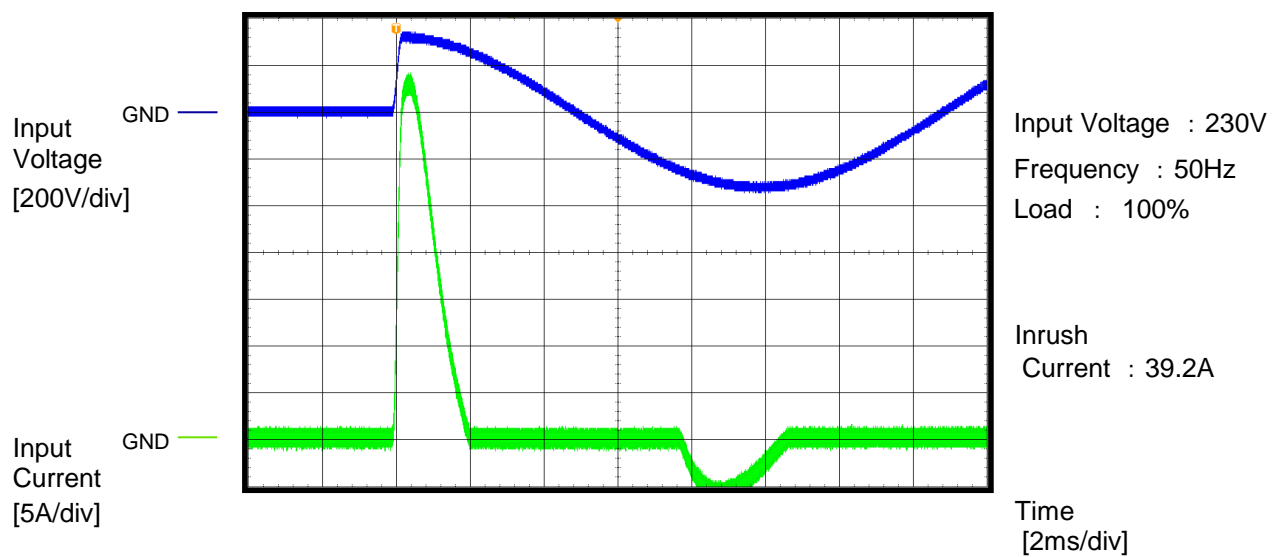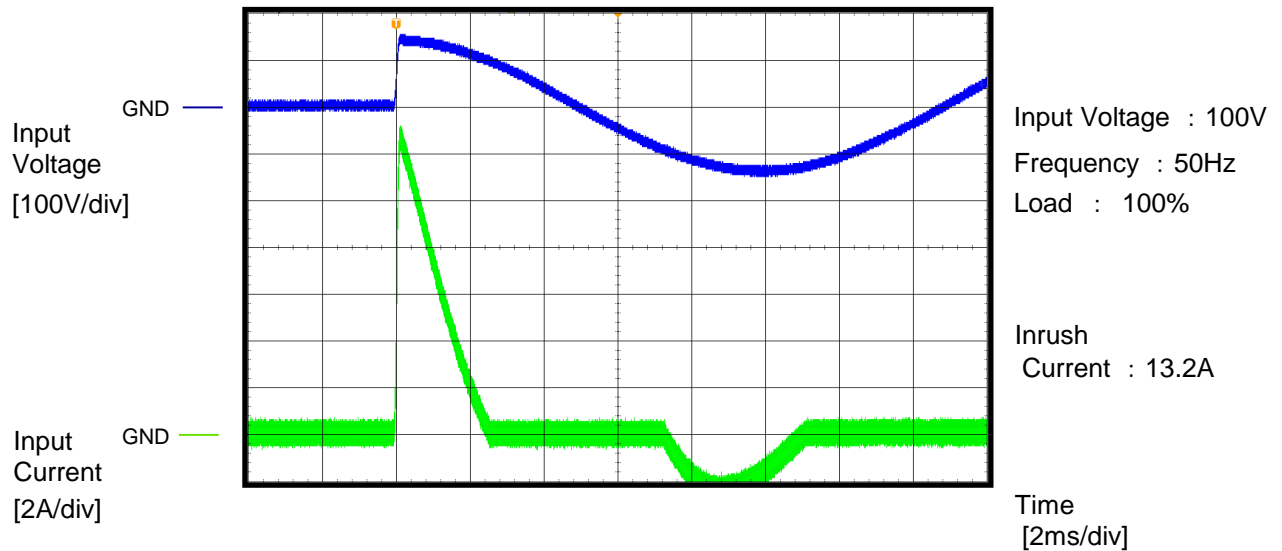

COSEL

Model	LHA50F-36	Temperature	25°C
Item	Dynamic Line Regulation	Testing Circuitry	A
Object	_____		

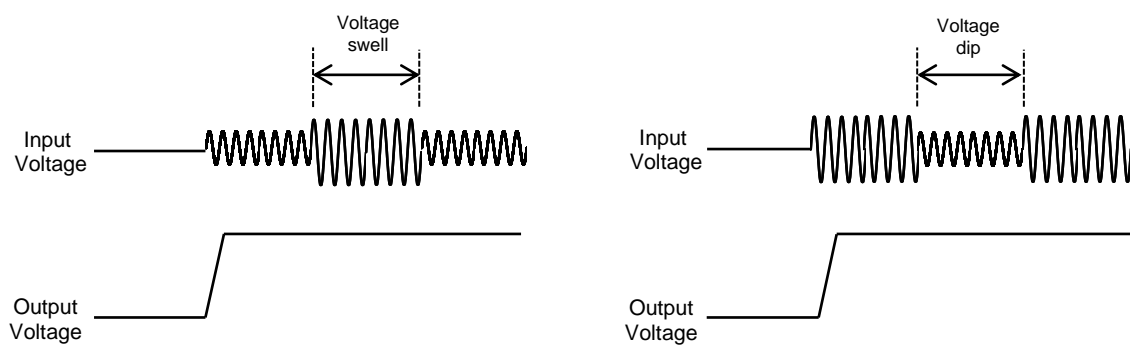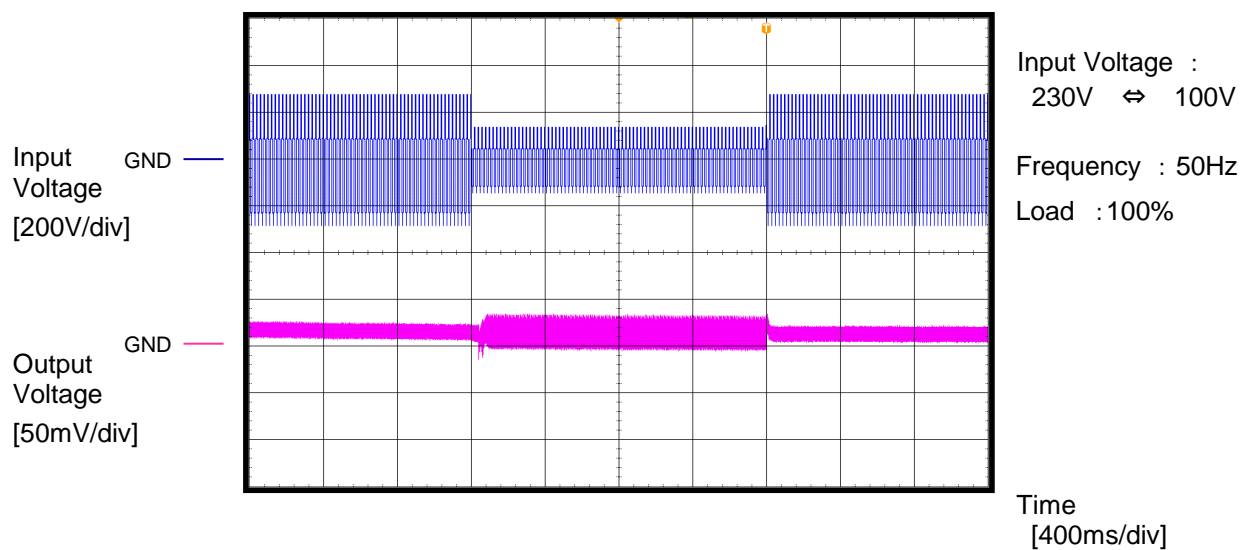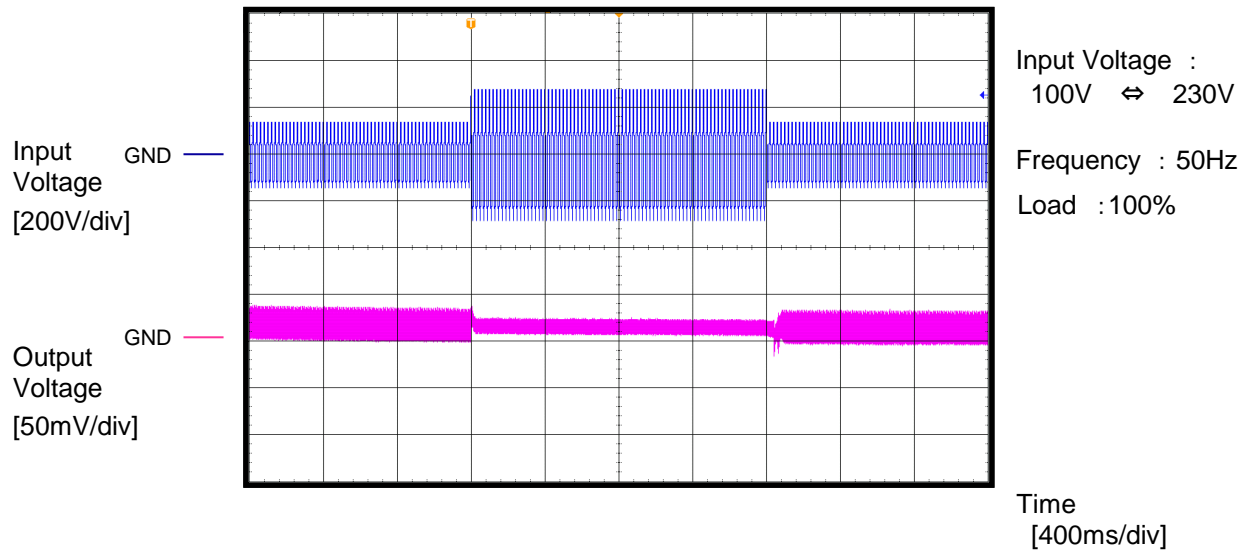

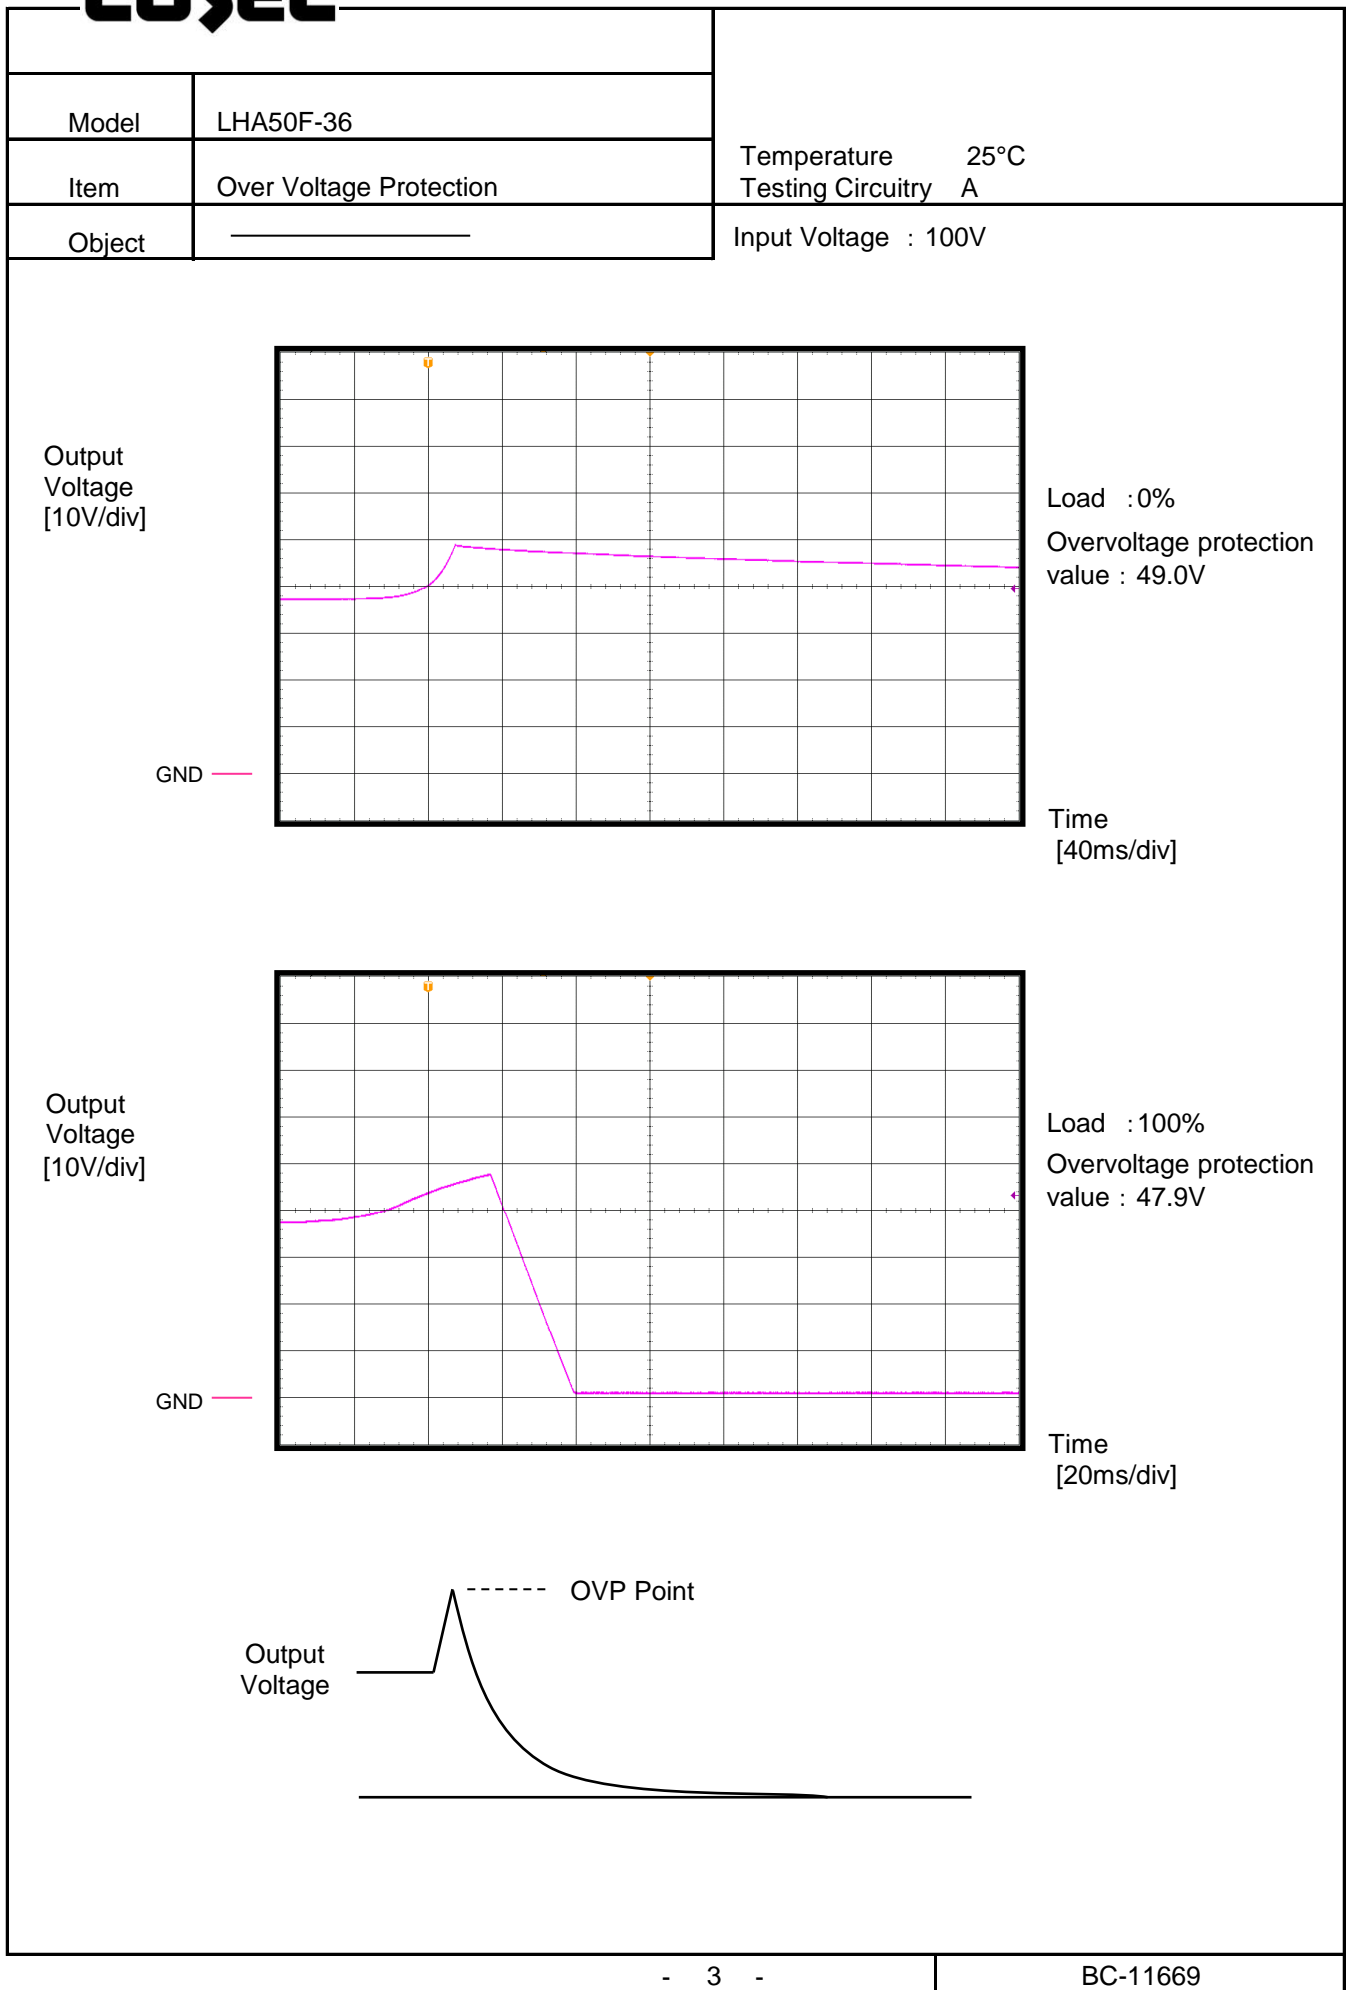
COSEL

COSEL

Model	LHA50F-36	Temperature	25°C
Item	Short Circuit Current	Testing Circuitry	A
Object	_____	Load	: Short

Output Current
[1A/div]

GND

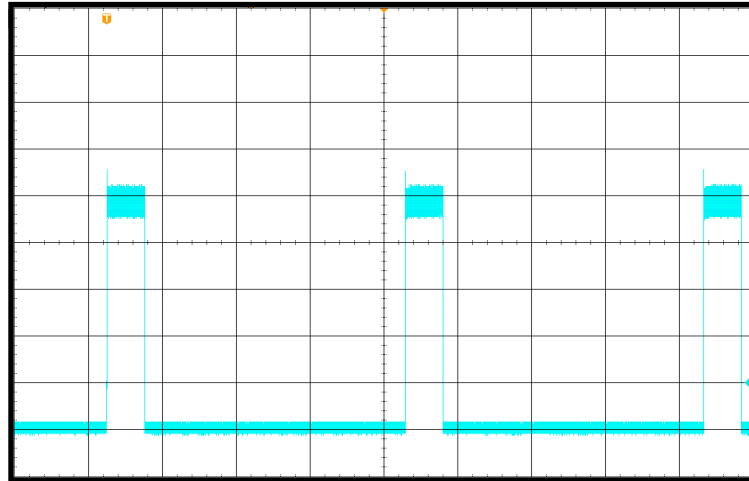


Input Voltage : 100V

Short-circuit
current : 5.6A

ON Time : 206ms

Short circuit
period : 1617msTime
[400ms/div]Output Current
[1A/div]


GND

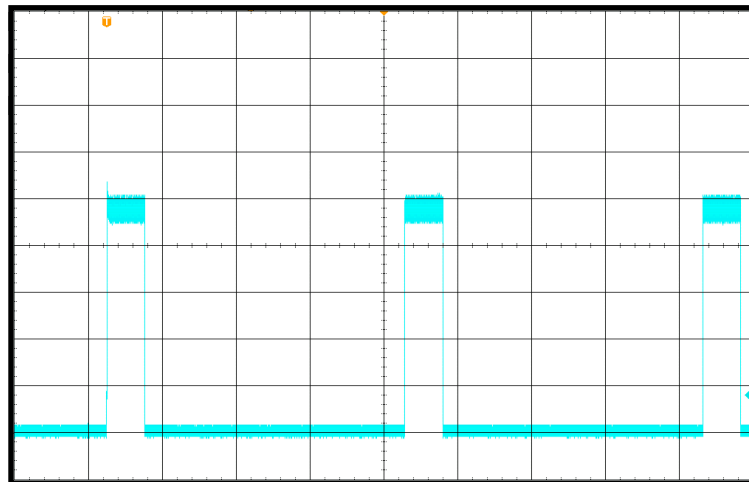

Input Voltage : 230V

Short-circuit
current : 5.4A

ON Time : 206ms

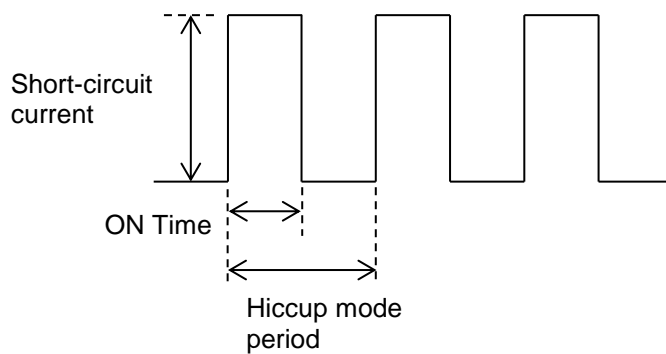Short circuit
period : 1617msTime
[400ms/div]

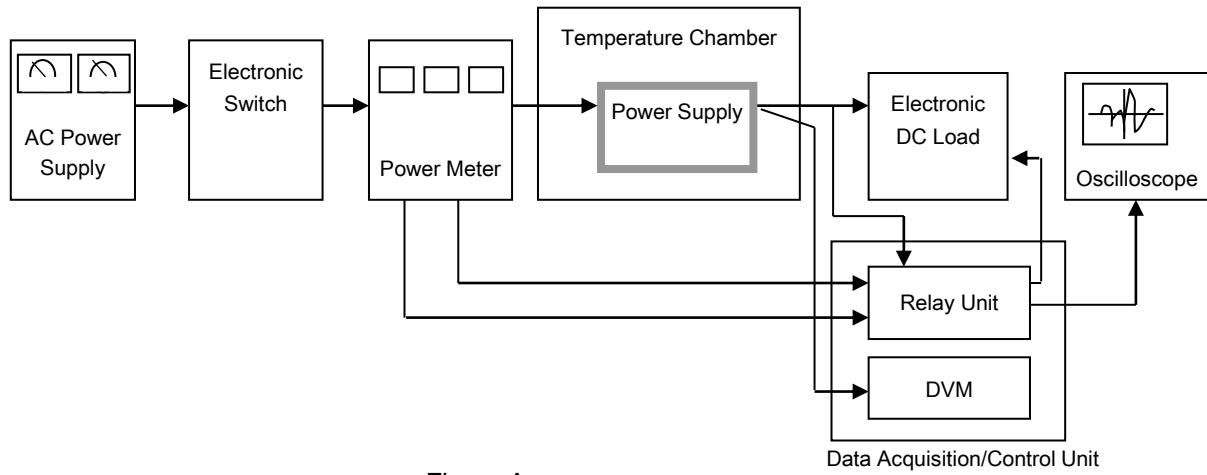


Figure A