



## ***EXTRA TEST DATA OF LHA75F-5***

*Regulated DC Power Supply*  
*Feb 20, 2021*

**COSEL CO.,LTD.**



## CONTENTS

1.Inrush Current (enlargement) . . . . .	1
2.Dynamic Line Regulation . . . . .	2
3.Overtoltage Protection (waveform) . . . . .	3
4.Hiccup cycle (by Overcurrent Protection) . . . . .	4
5.Figure of Testing Circuitry . . . . .	5

(Final Page 5)

**COSEL**

Model	LHA75F-5		
Item	Inrush Current (enlargement)	Temperature	25°C
Object	_____	Testing Circuitry	A

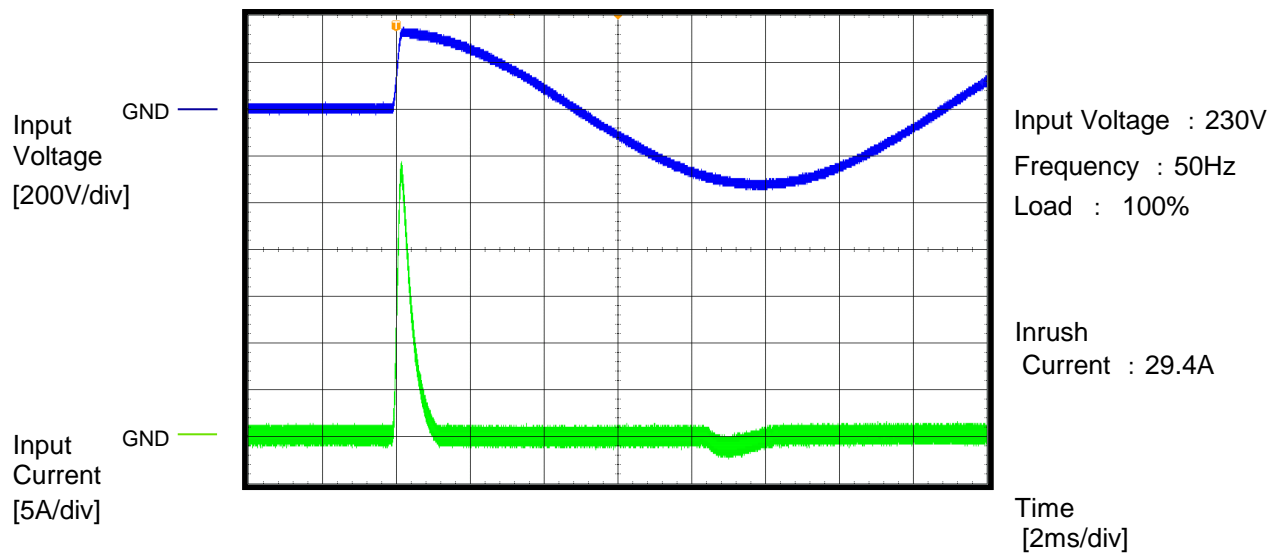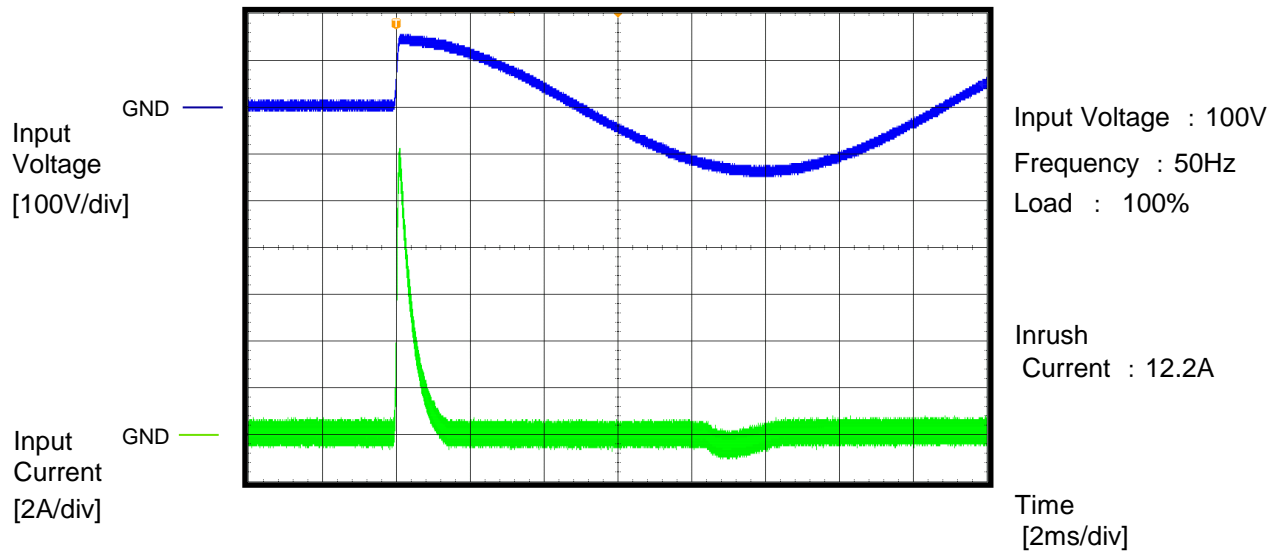


**COSEL**

Model	LHA75F-5	Temperature    25°C Testing Circuitry   A	
Item	Dynamic Line Regulation		
Object	_____		

Input Voltage  
[200V/div]

Output Voltage  
[50mV/div]

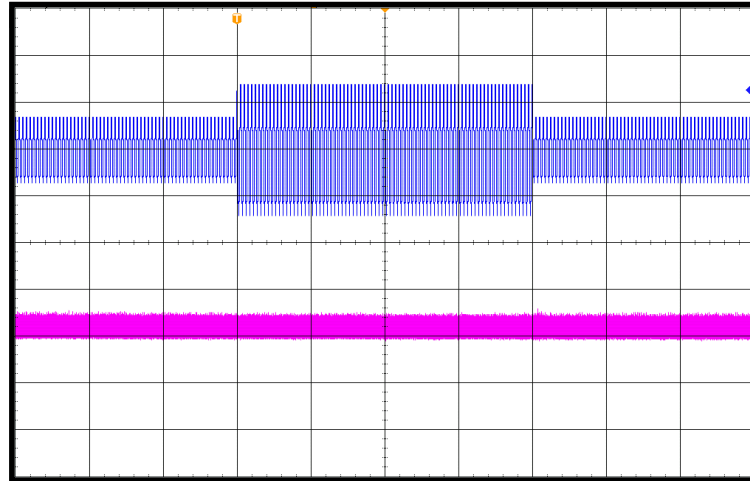


Input Voltage :  
100V  $\Leftrightarrow$  230V

Frequency : 50Hz  
Load : 100%

Time  
[400ms/div]

Input Voltage  
[200V/div]



Output Voltage  
[50mV/div]

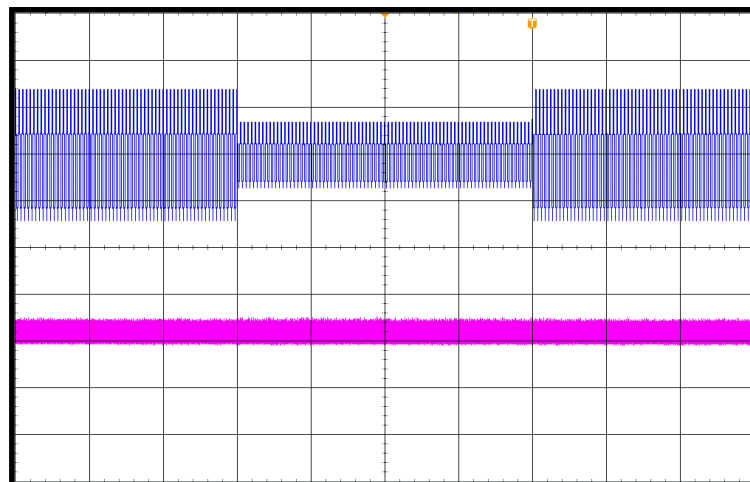


Input Voltage :  
230V  $\Leftrightarrow$  100V

Frequency : 50Hz  
Load : 100%

Time  
[400ms/div]

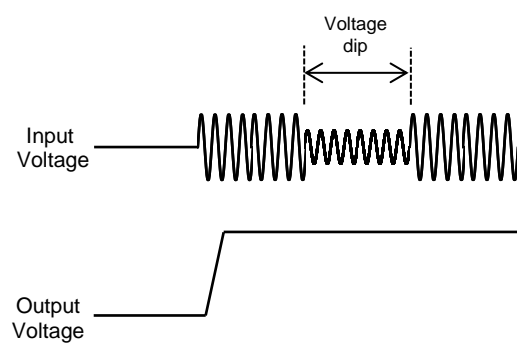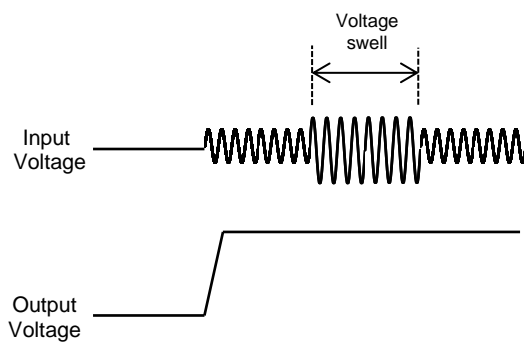


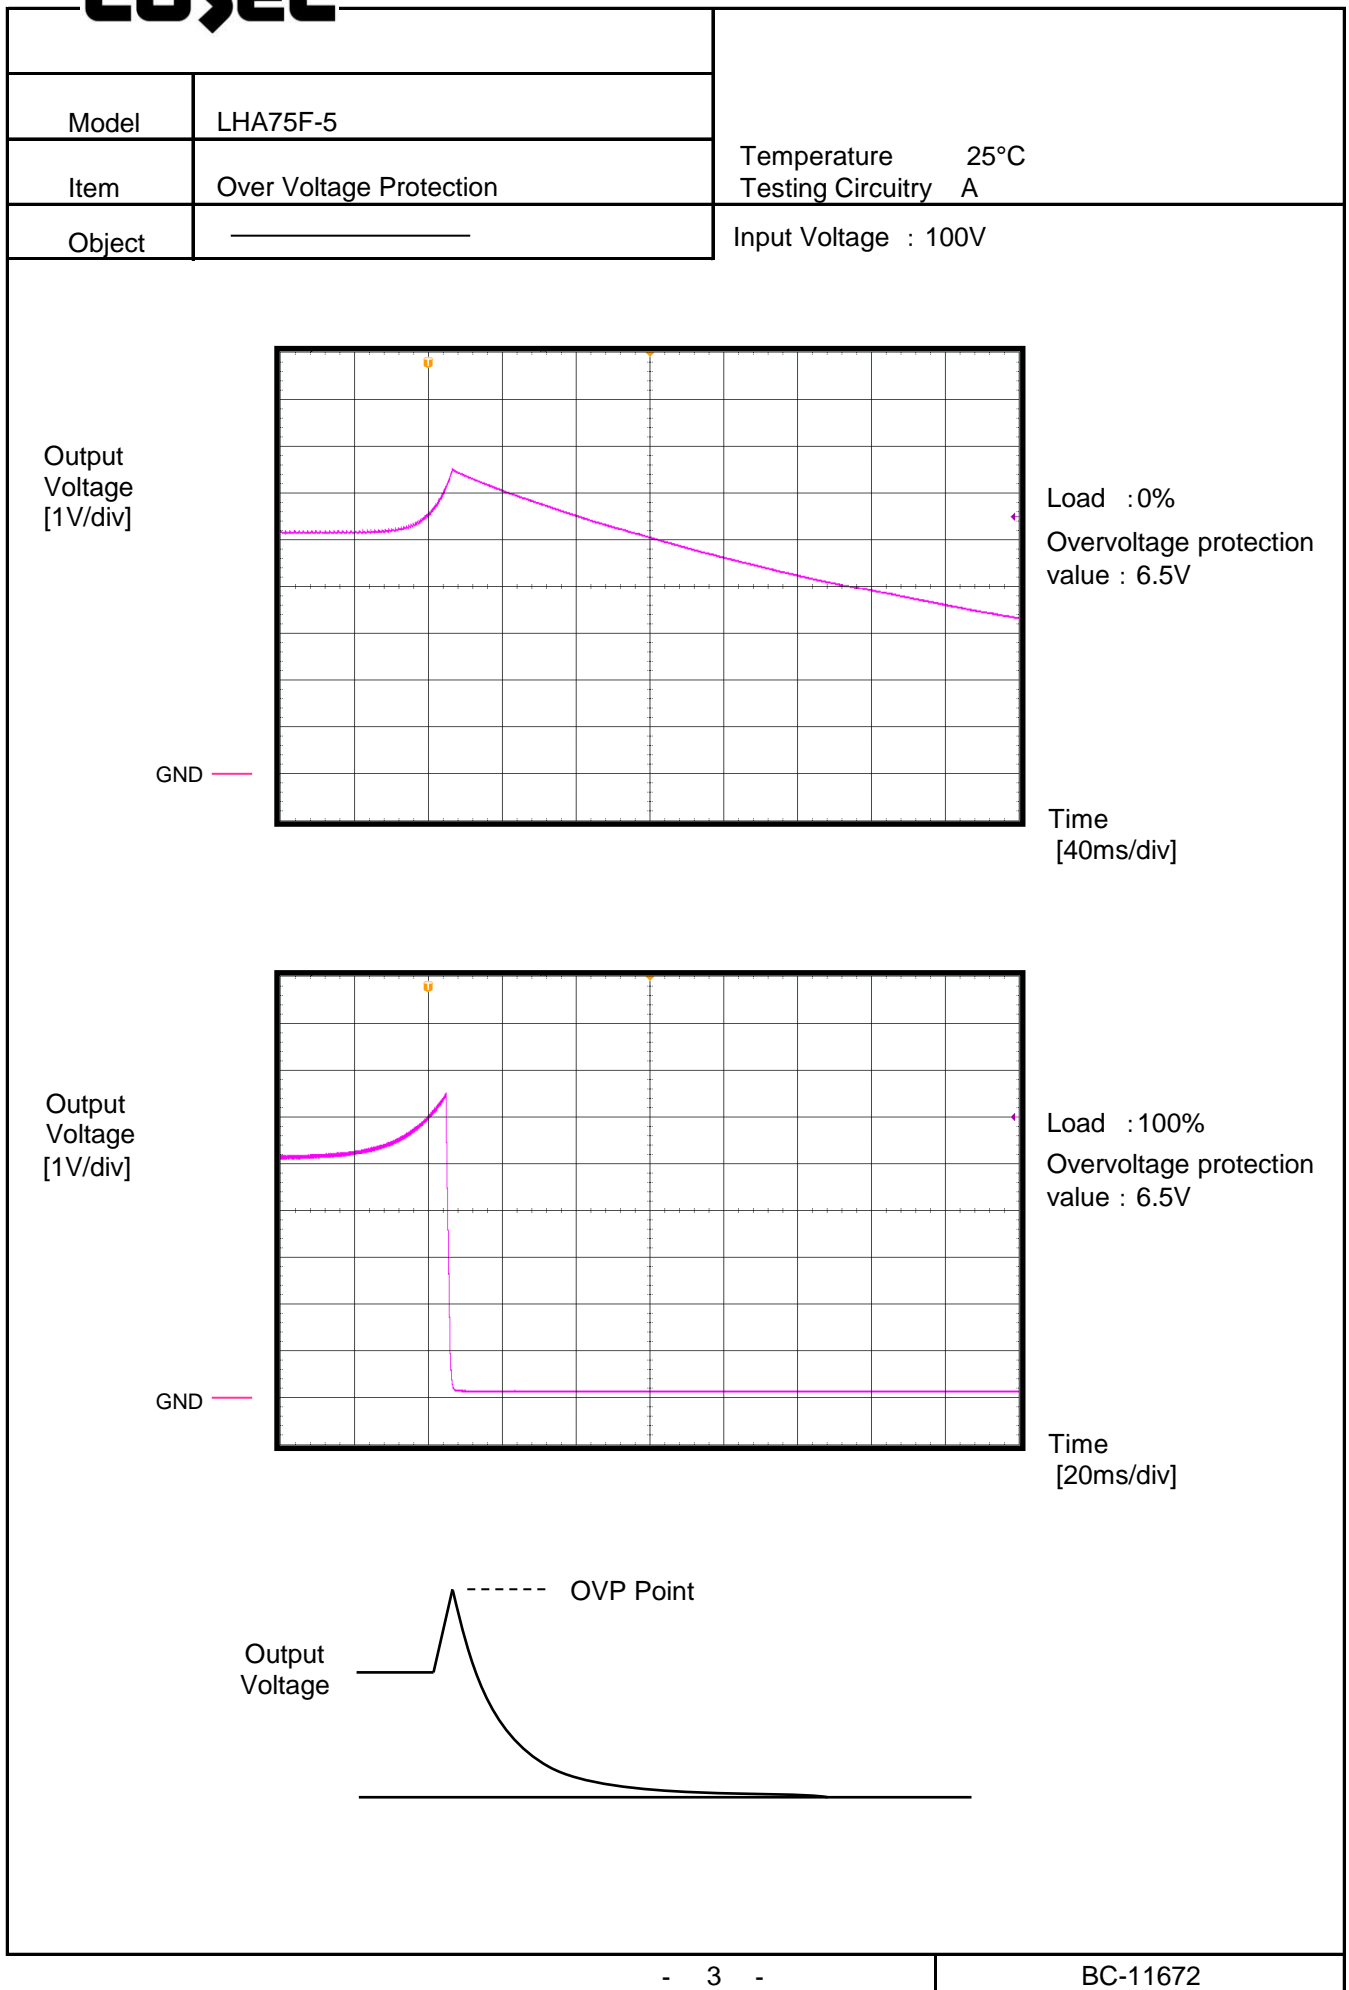**COSEL**

**COSEL**

		Temperature 25°C Testing Circuitry A Load : Short
Model	LHA75F-5	
Item	Short Circuit Current	
Object	_____	

Output  
Current  
[5A/div]

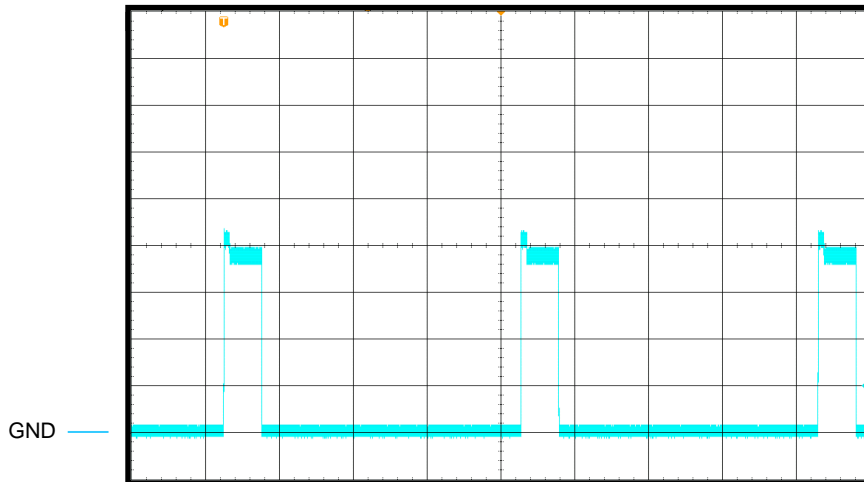

Input Voltage : 100V


Short-circuit  
current : 21.8A

ON Time : 205ms

Short circuit  
period : 1611ms

Time  
[400ms/div]

Output  
Current  
[5A/div]

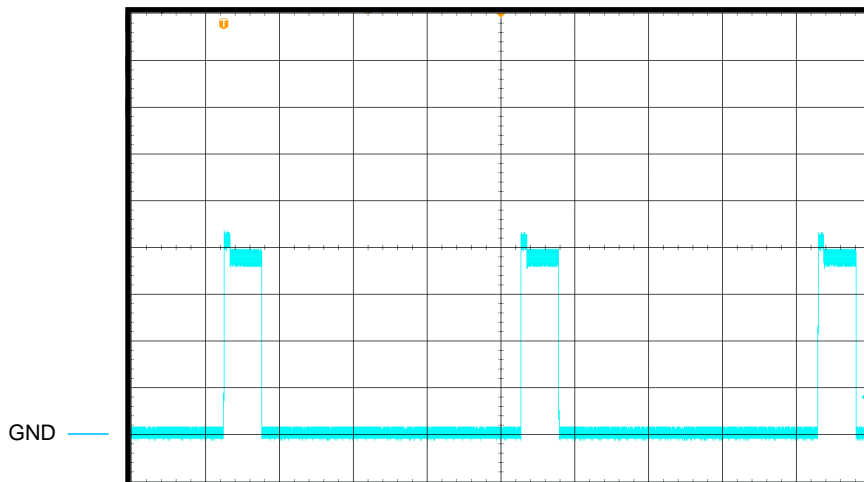


Input Voltage : 230V

Short-circuit  
current : 21.8A

ON Time : 205ms

Short circuit  
period : 1611ms

Time  
[400ms/div]

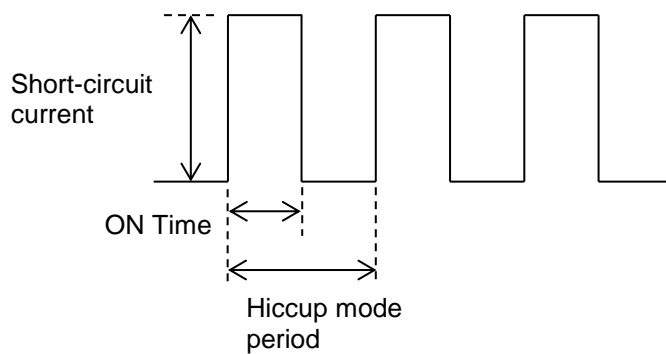

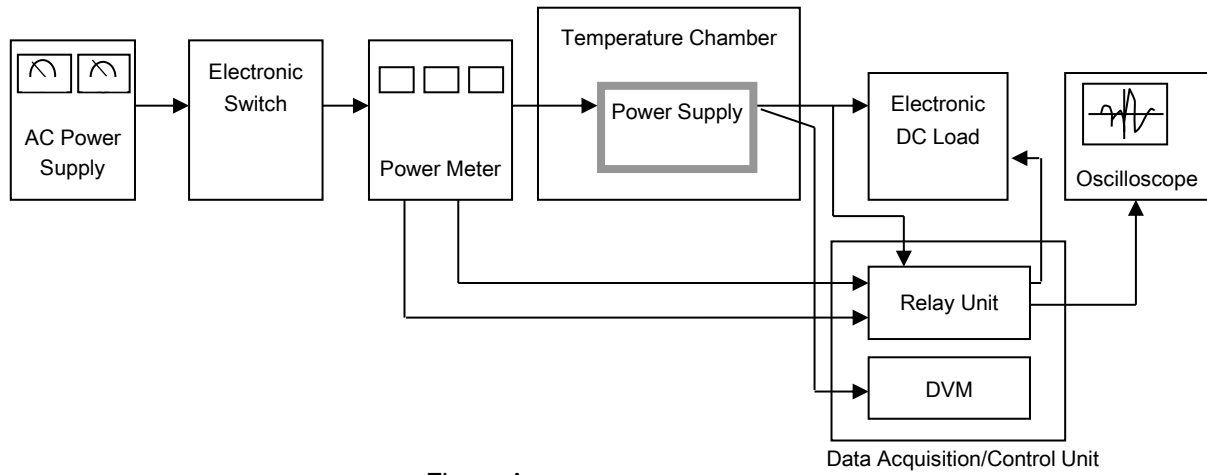


Figure A