



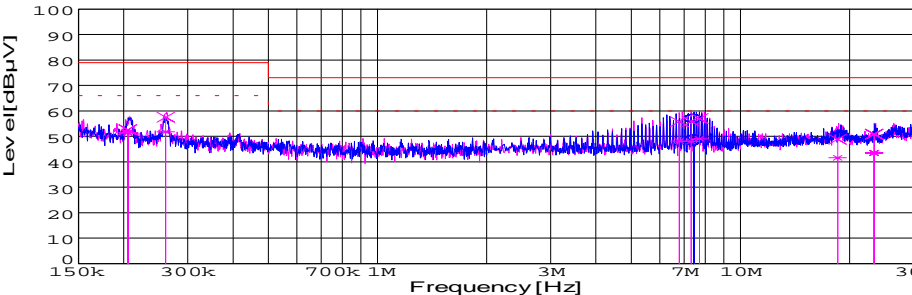
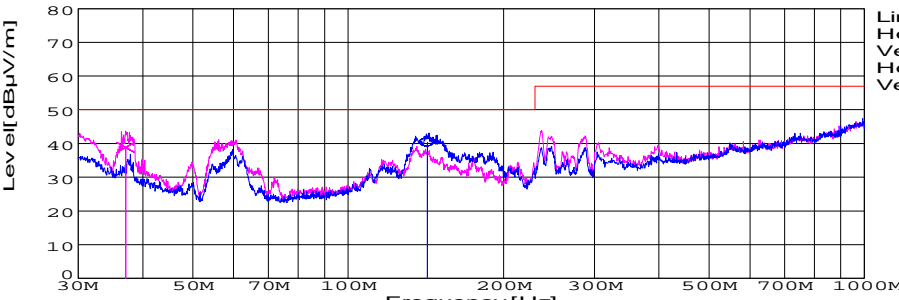
PBA1500F EMI/EMS Test result

September 16, 2004
Design engineering dep.

Approved : Takahiro Yamada

Prepared : Tsunehisa Sugimoto

No.	Test item	Conditions	Conditions of Acceptability	Result
1	Line conduction	(1) Rated input(AC100V,230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$	(1)Meets the undermentioned standard. FCC Part15 classA , VCCI classA CISPR22 classA , EN55011-A	OK
2	Radiated emission	(1) Rated input(AC100V,230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$	(1)Meets the undermentioned standard. FCC Part15 classA , VCCI classA CISPR22 classA , EN55011-A	OK
3	Harmonic current (EN61000-3-2)	(1) Rated input (AC100V,230V) (2) Load 0 - Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$	(1)Meets the undermentioned standard. EN61000-3-2 classA	OK
4	Static electricity immunity test (EN61000-4-2)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$ (4) Contact discharge voltage 8[kV] (Level 4)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
5	Radiated, radio-frequency, electromagnetic field immunity test (EN61000-4-3)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$ (4)Testing field strength 10[V/m] (Level 3)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
6	Electrical fast transient/ burst immunity test (EN61000-4-4)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$ (4) Test peak voltage 4[kV] (Level 4)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
7	Surge immunity test (EN61000-4-5)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$ (4) Test voltage Line to line 2[kV] (Level 3) Line to earth 4[kV] (Level 4)	(1)The power supply is not stop (2)Circuit does not malfunction. (3)No abnormality of the insulation destruction etc. (4)Parts are no damaged.	OK
8	Immunity to conducted disturbances, induced by radio-frequency fields (EN61000-4-6)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$ (4) Voltage level (e.m.f.) 10[V] (Level 3)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
9	Power frequency magnetic field immunity test (EN61000-4-8)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$ (4) Magnetic field 30A/m (Level 4)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
10	Voltage dips, short interruptions and voltage variations immunity test (EN61000-4-11)	(1) Rated input (AC230V) -30% reduction at 10mS min. -60% reduction at 100mS min -95% reduction at 5S min. - $\pm 10\%$ variation at 15 minutes (2) Rated load (3) Ambient temp. $25\pm 10^{\circ}\text{C}$	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK

DATA SHEET							Date	10-Mar-03																																																																																																					
Model	PBA1500F-24						Temp.	25 degreeC																																																																																																					
Test	EMI Line conduction & Radiated emission						Humid.	45 %RH																																																																																																					
							Tested by	T.Kubota																																																																																																					
LINE CONDUCTION																																																																																																													
Model Name : PBA1500F-24			Temp. : 25																																																																																																										
Model No. :			Humi. : 45																																																																																																										
Serial No. :			Date : 2003/3/10 15:01																																																																																																										
Points : 8			Test Equip. : R3132,ESPC																																																																																																										
Detector : PEAK/QP/Ave.			Comment : T.Kubota																																																																																																										
Line Mode : VA/VB			+24V 70A																																																																																																										
Power Supply : AC 230V 50Hz																																																																																																													
Limit1: [EN 55011] Class A Gr.1(QP)																																																																																																													
Limit2: [EN 55011] Class A Gr.1(Ave.)																																																																																																													
							Limit1(QP) Limit2(Ave.) VA(PEAK) VB(PEAK) VA(QP) VA(Ave.) VB(QP) VB(Ave.)																																																																																																						
							AC 230V 50Hz +24V 70A																																																																																																						
<table><tr><th>Frequency [MHz]</th><th>Meter Reading (Ave.) [dBuV]</th><th>Meter Reading (QP) [dBuV]</th><th>Factor [dB]</th><th>Level(Ave.) [dBuV]</th><th>Level(QP) [dBuV]</th><th>Line</th><th>Limit(Ave.) [dBuV]</th><th>Limit(QP) [dBuV]</th><th>Margin(Ave.) [dB]</th><th>Margin(QP) [dB]</th></tr><tr><td>0.205</td><td>41.6</td><td>42.8</td><td>9.8</td><td>51.4</td><td>52.6</td><td>VB</td><td>66</td><td>79</td><td>14.6</td><td>26.4</td></tr><tr><td>0.2611</td><td>42</td><td>47.7</td><td>9.8</td><td>51.8</td><td>57.5</td><td>VB</td><td>66</td><td>79</td><td>14.2</td><td>21.5</td></tr><tr><td>6.7893</td><td>38.2</td><td>45.8</td><td>10</td><td>48.2</td><td>55.8</td><td>VB</td><td>60</td><td>73</td><td>11.8</td><td>17.2</td></tr><tr><td>7.315</td><td>37.9</td><td>45.8</td><td>10.1</td><td>48</td><td>55.9</td><td>VB</td><td>60</td><td>73</td><td>12</td><td>17.1</td></tr><tr><td>7.4418</td><td>38.2</td><td>46.6</td><td>10.1</td><td>48.3</td><td>56.7</td><td>VA</td><td>60</td><td>73</td><td>11.7</td><td>16.3</td></tr><tr><td>7.7073</td><td>39</td><td>46.9</td><td>10.1</td><td>49.1</td><td>57</td><td>VB</td><td>60</td><td>73</td><td>10.9</td><td>16</td></tr><tr><td>18.5434</td><td>31.3</td><td>38.7</td><td>10.2</td><td>41.5</td><td>48.9</td><td>VB</td><td>60</td><td>73</td><td>18.5</td><td>24.1</td></tr><tr><td>23.3729</td><td>33.2</td><td>40.6</td><td>10.3</td><td>43.5</td><td>50.9</td><td>VB</td><td>60</td><td>73</td><td>16.5</td><td>22.1</td></tr></table>											Frequency [MHz]	Meter Reading (Ave.) [dBuV]	Meter Reading (QP) [dBuV]	Factor [dB]	Level(Ave.) [dBuV]	Level(QP) [dBuV]	Line	Limit(Ave.) [dBuV]	Limit(QP) [dBuV]	Margin(Ave.) [dB]	Margin(QP) [dB]	0.205	41.6	42.8	9.8	51.4	52.6	VB	66	79	14.6	26.4	0.2611	42	47.7	9.8	51.8	57.5	VB	66	79	14.2	21.5	6.7893	38.2	45.8	10	48.2	55.8	VB	60	73	11.8	17.2	7.315	37.9	45.8	10.1	48	55.9	VB	60	73	12	17.1	7.4418	38.2	46.6	10.1	48.3	56.7	VA	60	73	11.7	16.3	7.7073	39	46.9	10.1	49.1	57	VB	60	73	10.9	16	18.5434	31.3	38.7	10.2	41.5	48.9	VB	60	73	18.5	24.1	23.3729	33.2	40.6	10.3	43.5	50.9	VB	60	73	16.5	22.1
Frequency [MHz]	Meter Reading (Ave.) [dBuV]	Meter Reading (QP) [dBuV]	Factor [dB]	Level(Ave.) [dBuV]	Level(QP) [dBuV]	Line	Limit(Ave.) [dBuV]	Limit(QP) [dBuV]	Margin(Ave.) [dB]	Margin(QP) [dB]																																																																																																			
0.205	41.6	42.8	9.8	51.4	52.6	VB	66	79	14.6	26.4																																																																																																			
0.2611	42	47.7	9.8	51.8	57.5	VB	66	79	14.2	21.5																																																																																																			
6.7893	38.2	45.8	10	48.2	55.8	VB	60	73	11.8	17.2																																																																																																			
7.315	37.9	45.8	10.1	48	55.9	VB	60	73	12	17.1																																																																																																			
7.4418	38.2	46.6	10.1	48.3	56.7	VA	60	73	11.7	16.3																																																																																																			
7.7073	39	46.9	10.1	49.1	57	VB	60	73	10.9	16																																																																																																			
18.5434	31.3	38.7	10.2	41.5	48.9	VB	60	73	18.5	24.1																																																																																																			
23.3729	33.2	40.6	10.3	43.5	50.9	VB	60	73	16.5	22.1																																																																																																			
RADIATED EMISSION																																																																																																													
Model Name : PBA1500F-24			Temp. : 25																																																																																																										
Model No. :			Humi. : 45																																																																																																										
Serial No. :			Date : 2003/3/10 13:37																																																																																																										
Points : 2			Test Equip. : R3132,ESPC																																																																																																										
Detector : PEAK/QP			Comment : T.Kubota																																																																																																										
Polarization : Hori. & Vert.			+24V 70A																																																																																																										
Power Supply : AC 230V 50Hz																																																																																																													
Limit: [EN 55011] Class A Group 1<3m>																																																																																																													
							Limit(QP) Horizontal(PEAK) Vertical(PEAK) Horizontal(QP) Vertical(QP)																																																																																																						
							AC 230V 50Hz +24V 70A																																																																																																						
<table><tr><th>Frequency [MHz]</th><th>Meter Reading (QP) [dBuV]</th><th>Ant. Type</th><th>Antenna Factor [dB/m]</th><th>Cable & Preamp [dB]</th><th>Level(QP) [dBuV/m]</th><th>Angle [°]</th><th>Height [cm]</th><th>Polar.</th><th>Limit [dBuV/m]</th><th>Margin [dB]</th></tr><tr><td>37.066</td><td>56.4</td><td>BL</td><td>14.6</td><td>-32.2</td><td>38.8</td><td>6</td><td>100</td><td>Vert.</td><td>50</td><td>11.2</td></tr><tr><td>142.41</td><td>61</td><td>BL</td><td>10.8</td><td>-31.6</td><td>40.2</td><td>202</td><td>142</td><td>Hori.</td><td>50</td><td>9.8</td></tr></table>											Frequency [MHz]	Meter Reading (QP) [dBuV]	Ant. Type	Antenna Factor [dB/m]	Cable & Preamp [dB]	Level(QP) [dBuV/m]	Angle [°]	Height [cm]	Polar.	Limit [dBuV/m]	Margin [dB]	37.066	56.4	BL	14.6	-32.2	38.8	6	100	Vert.	50	11.2	142.41	61	BL	10.8	-31.6	40.2	202	142	Hori.	50	9.8																																																																		
Frequency [MHz]	Meter Reading (QP) [dBuV]	Ant. Type	Antenna Factor [dB/m]	Cable & Preamp [dB]	Level(QP) [dBuV/m]	Angle [°]	Height [cm]	Polar.	Limit [dBuV/m]	Margin [dB]																																																																																																			
37.066	56.4	BL	14.6	-32.2	38.8	6	100	Vert.	50	11.2																																																																																																			
142.41	61	BL	10.8	-31.6	40.2	202	142	Hori.	50	9.8																																																																																																			