



EXTRA TEST DATA OF PJA300F-24


Regulated DC Power Supply
Nov 20, 2021

COSEL CO.,LTD.

CONTENTS




1.Inrush Current (enlargement)	1
2.Dynamic Line Regulation	2
3.Overtoltage Protection (waveform)	3
4.Hiccup cycle (by Overcurrent Protection)	4
5.Power Consumption (by Input Voltage)	5
6.Figure of Testing Circuitry	6

(Final Page 6)

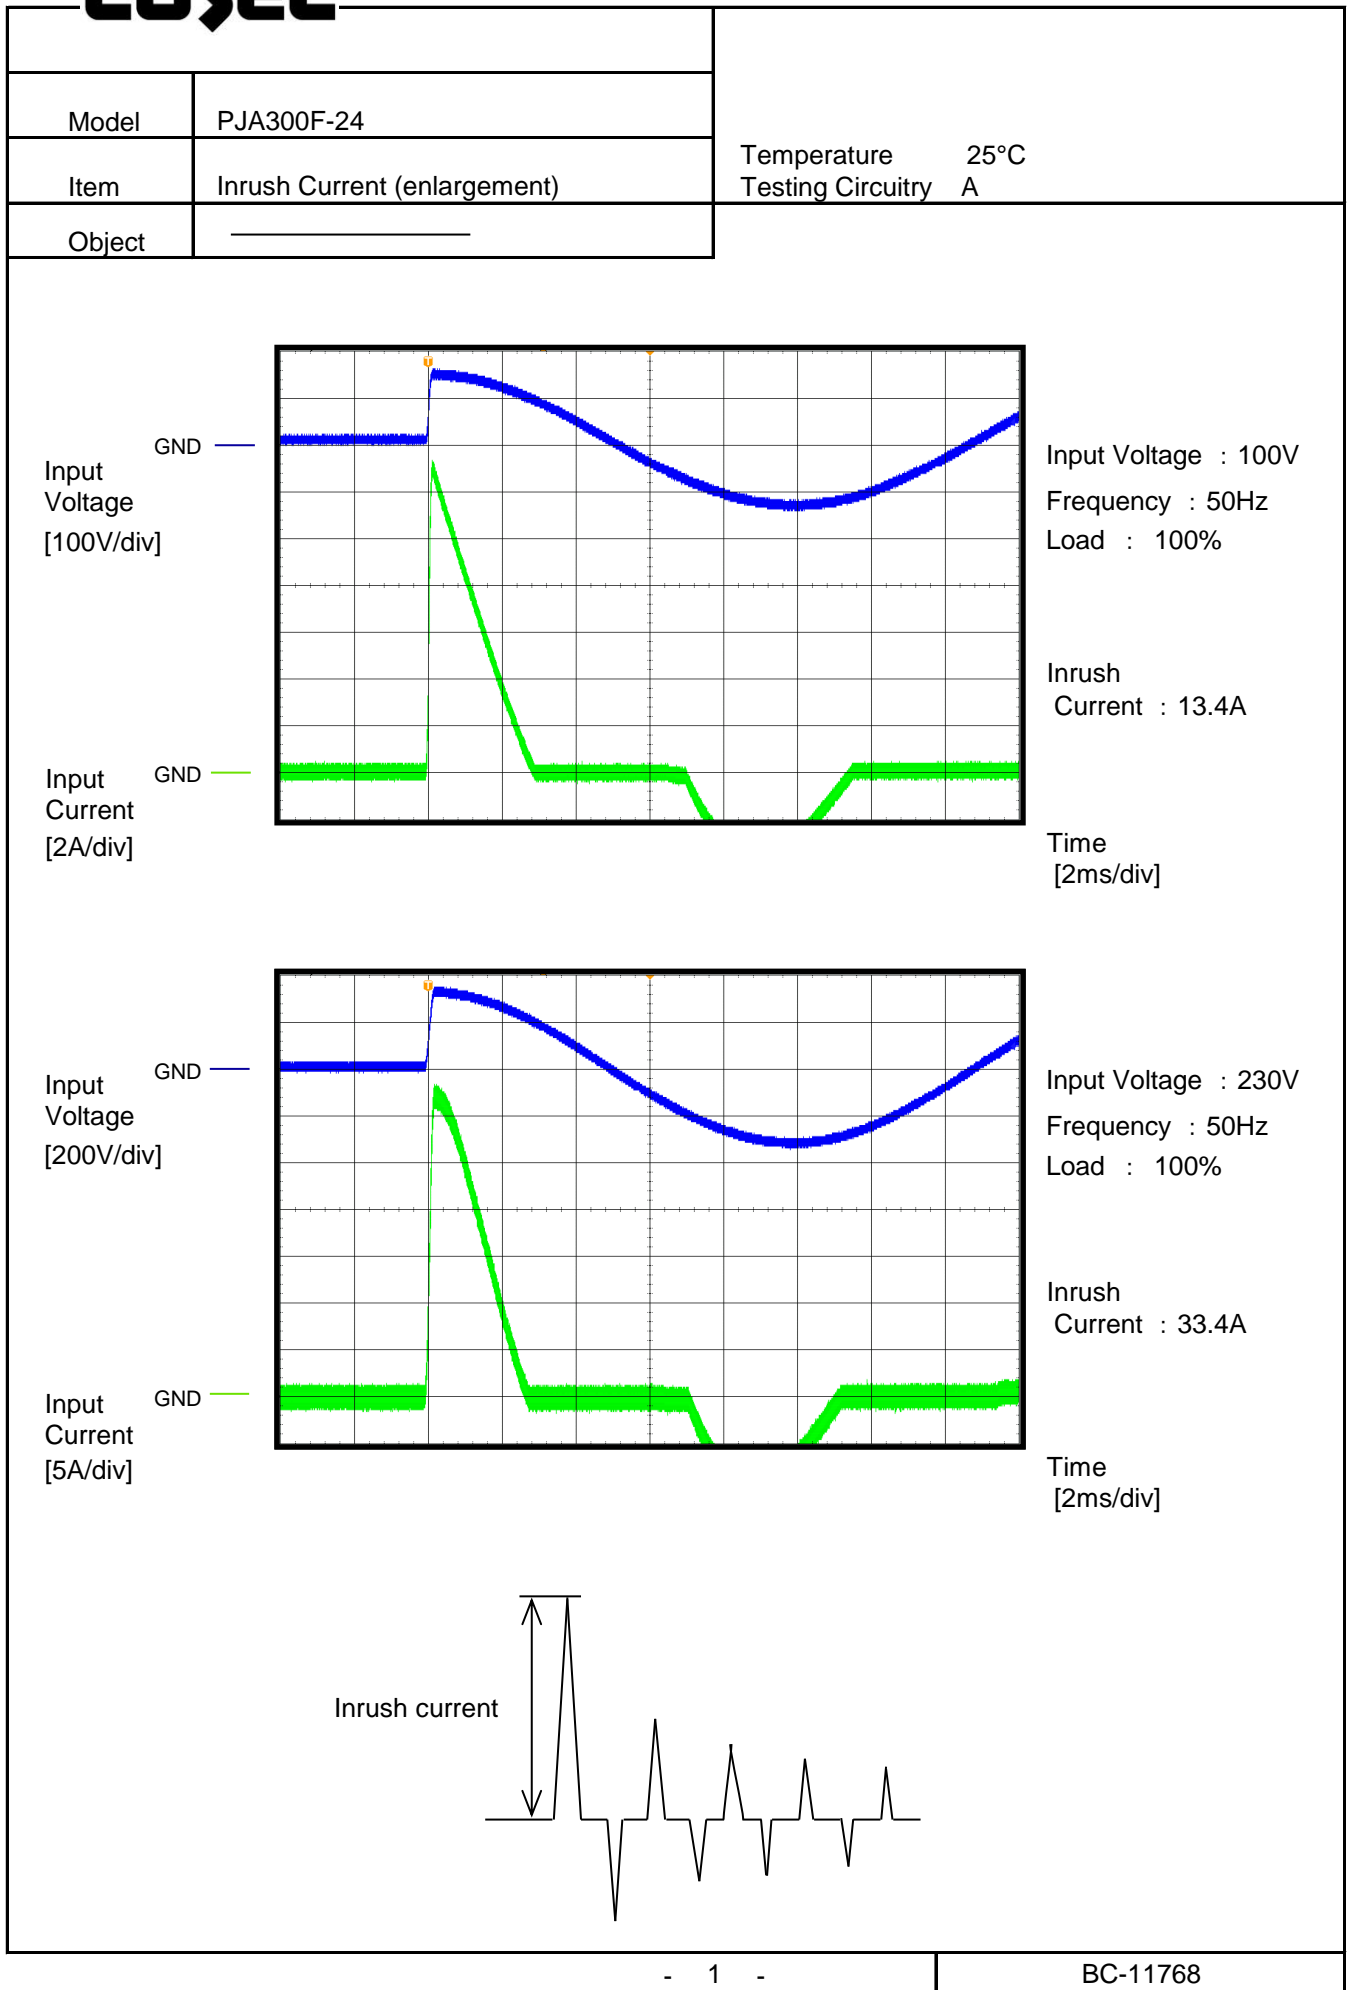COSEL

COSEL


Model	PJA300F-24	Temperature	25°C
Item	Dynamic Line Regulation	Testing Circuitry	A
Object	_____		

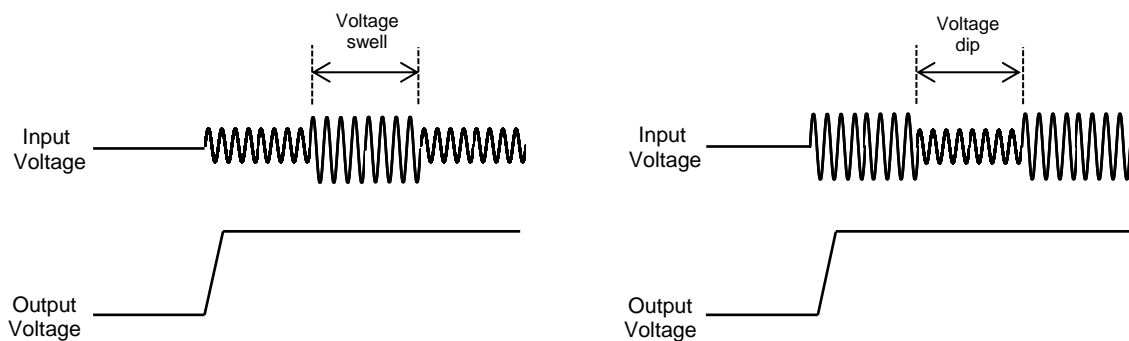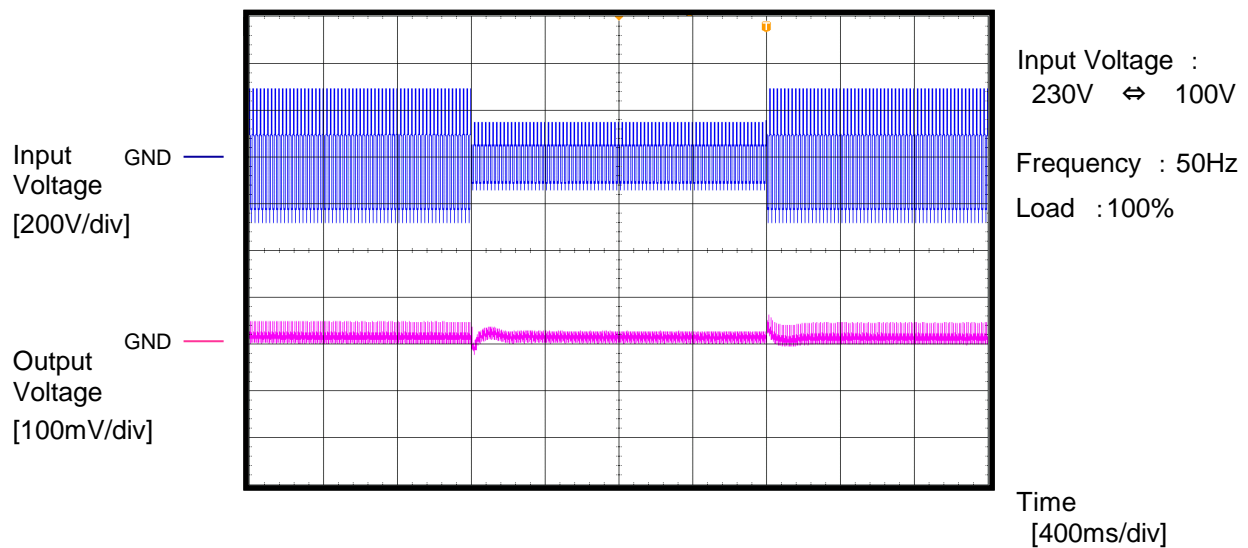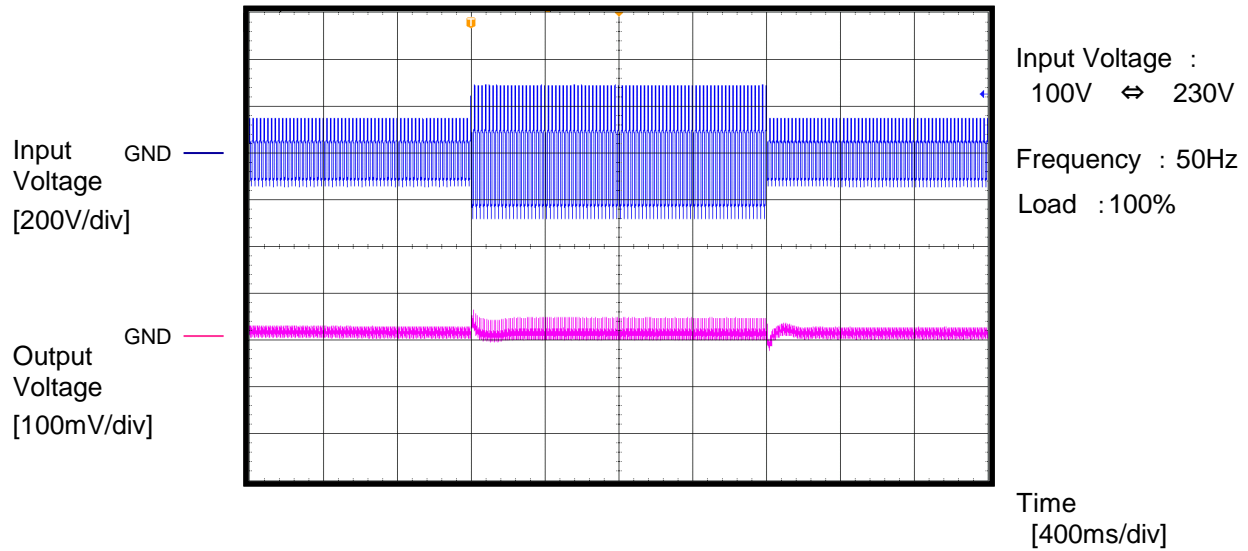

COSEL

Model	PJA300F-24	Temperature	25°C
Item	Over Voltage Protection	Testing Circuitry	A
Object	_____	Input Voltage : 100V	


Output
Voltage
[5V/div]

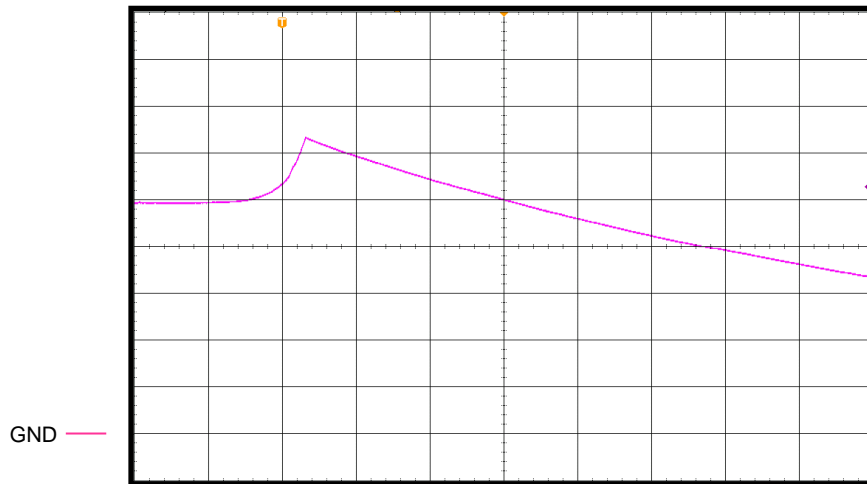

Load : 0%
Overvoltage protection
value : 31.7V


Time
[40ms/div]

Output
Voltage
[5V/div]

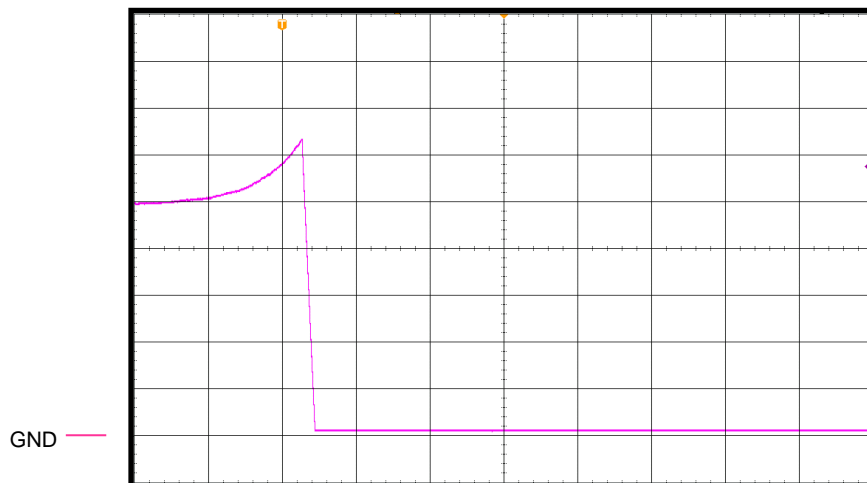


Load : 100%
Overvoltage protection
value : 31.7V

Time
[20ms/div]

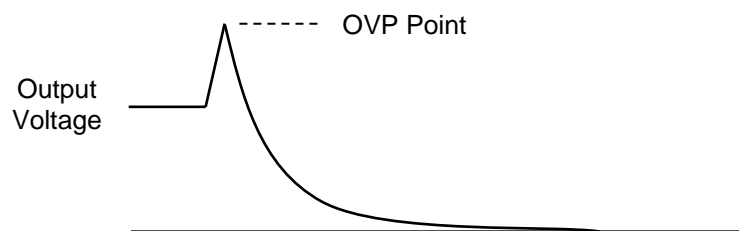

COSEL

Model	PJA300F-24	Temperature	25°C
Item	Hiccup cycle (by Overcurrent Protection)	Testing Circuitry	A
Object	_____	Load	: Short

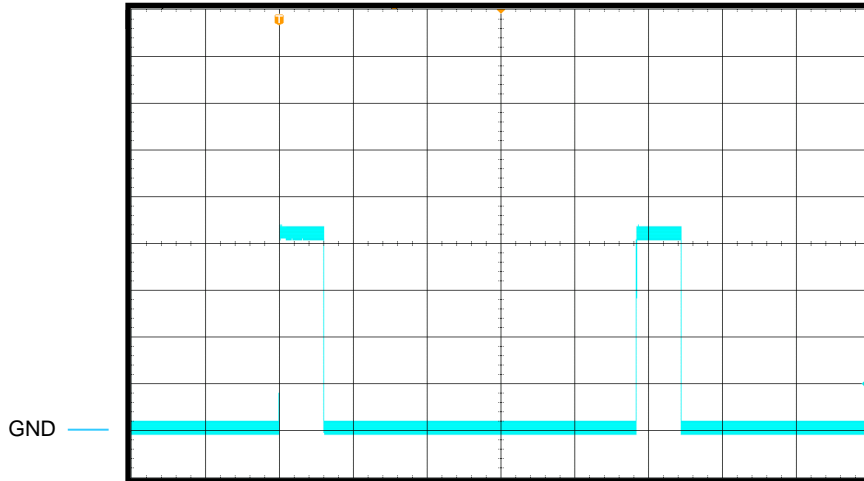
Output Current
[5A/div]

Input Voltage : 100V

Short-circuit current : 22A

ON Time : 1214ms

Short circuit period : 9676ms

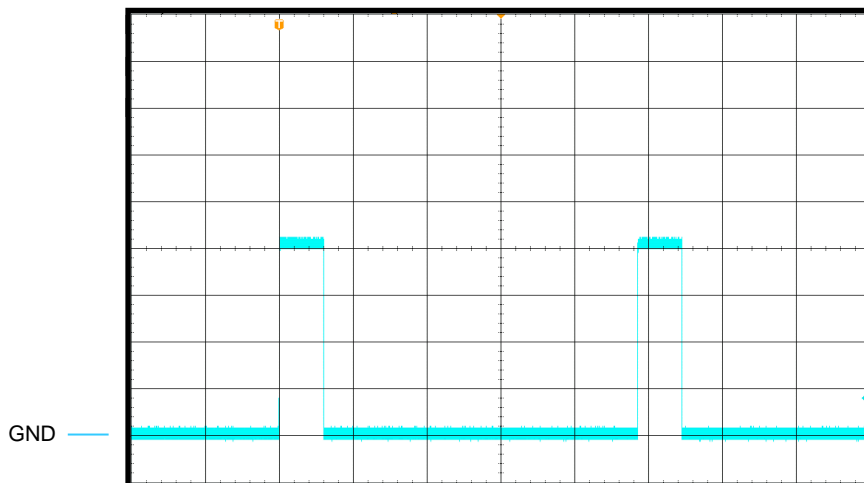
Time
[2000ms/div]Output Current
[5A/div]


Input Voltage : 230V

Short-circuit current : 21.2A

ON Time : 1218ms

Short circuit period : 9705ms

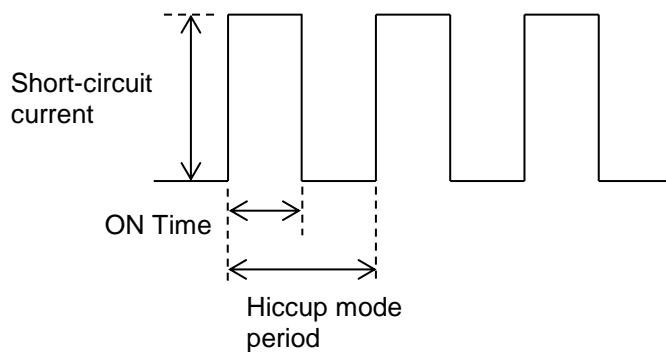Time
[2000ms/div]

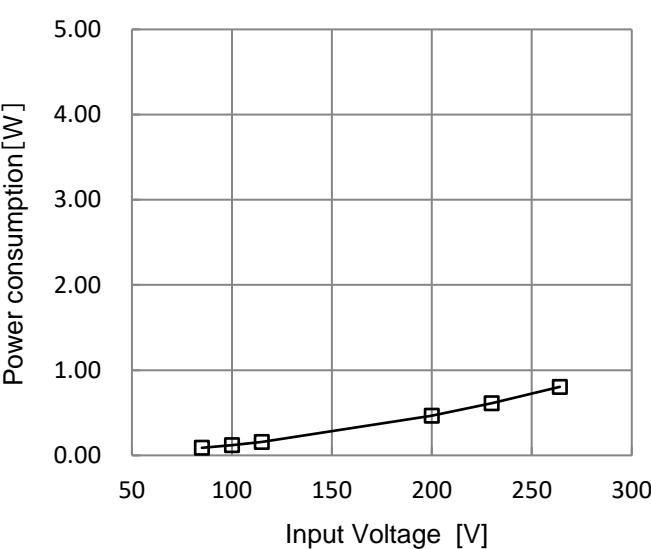Model	PJA300F-24-R																
Item	Input voltage - Power consumption	Temperature	25°C														
Object	_____	Testing Circuitry	-														
1.Graph		Load :0%															
		2.Values															
		<table><tr><th>Input voltage [V]</th><th>Power consumption [W]</th></tr><tr><td>85</td><td>0.09</td></tr><tr><td>100</td><td>0.12</td></tr><tr><td>115</td><td>0.16</td></tr><tr><td>200</td><td>0.47</td></tr><tr><td>230</td><td>0.61</td></tr><tr><td>264</td><td>0.80</td></tr></table>		Input voltage [V]	Power consumption [W]	85	0.09	100	0.12	115	0.16	200	0.47	230	0.61	264	0.80
Input voltage [V]	Power consumption [W]																
85	0.09																
100	0.12																
115	0.16																
200	0.47																
230	0.61																
264	0.80																
Reducing standby power is possible by OFF signal of the remote control.																	

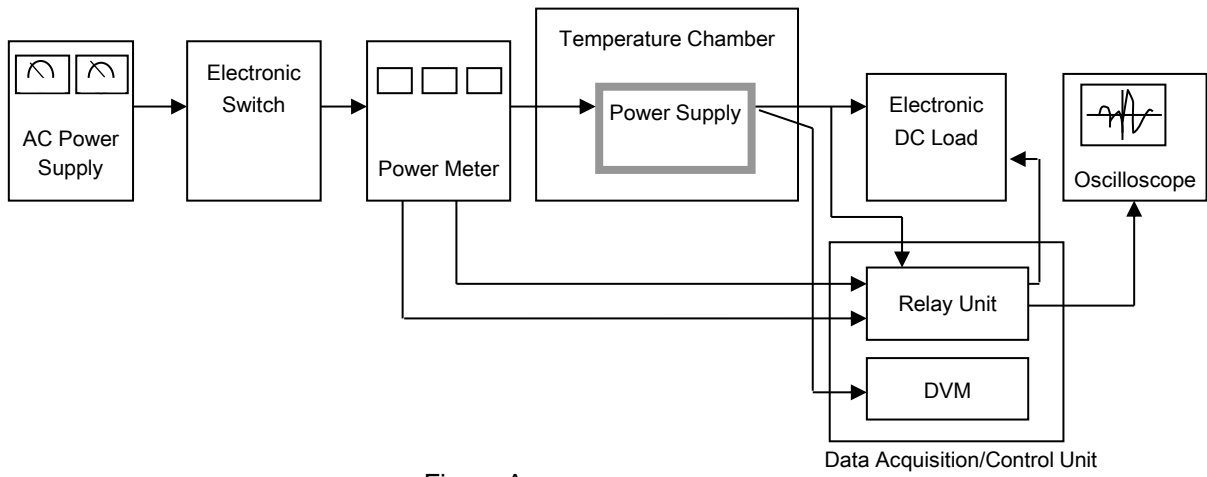


Figure A