

TEST DATA OF TAC-200-□□□

Noise Filter

March. 19. 2009

Approved by : Toshio Watanabe Watanabe
Toshio Watanabe Design Manager

Prepared by : Yuichi Uozu Uozu
Yuichi Uozu Design Engineer



COSEL CO.,LTD.

CONTENTS

1. Attenuation Characteristics	1
2. Leakage Current	3
3. Figure of Testing Circuitry	4
(Final Page 4)	

COSEL


Model	TAC-200-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	_____		

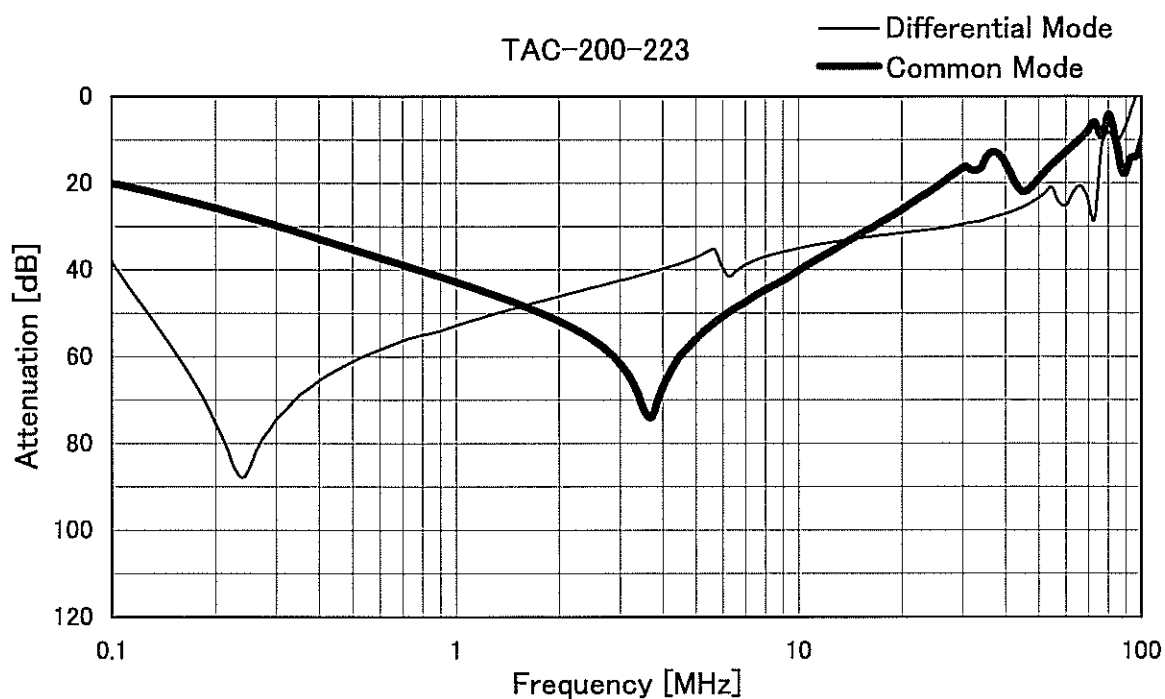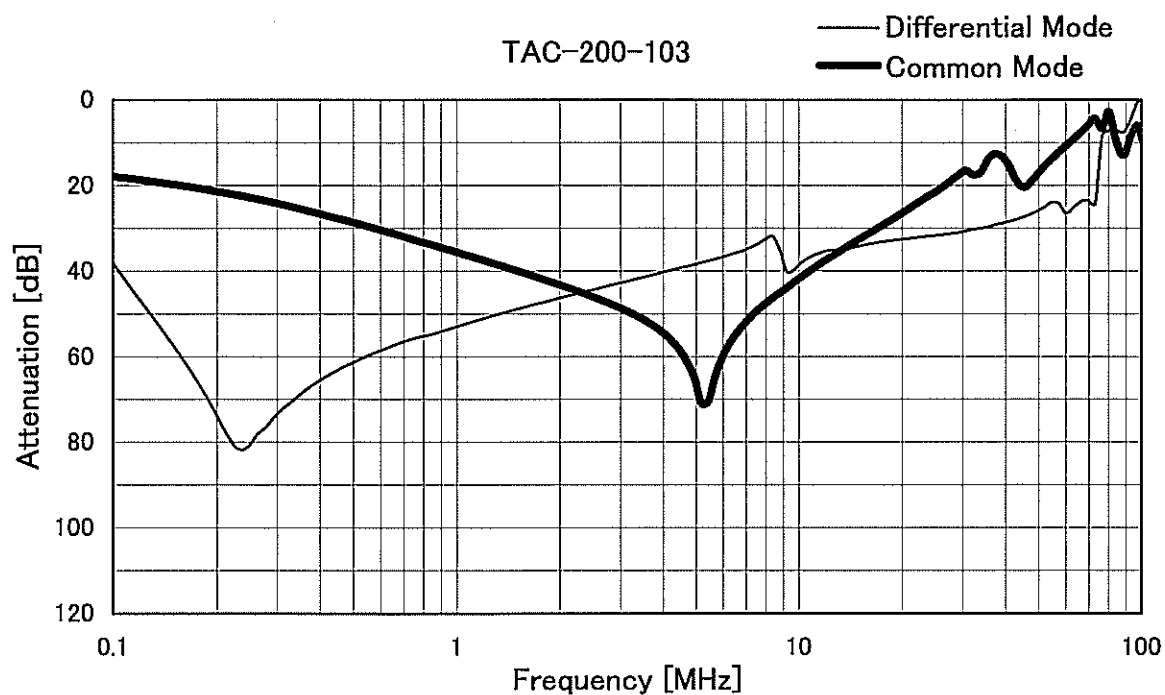

COSEL

Model	TAC-200-□□□
Item	Attenuation Characteristics
Object	_____

Temperature 25°C
Testing Circuitry Figure A

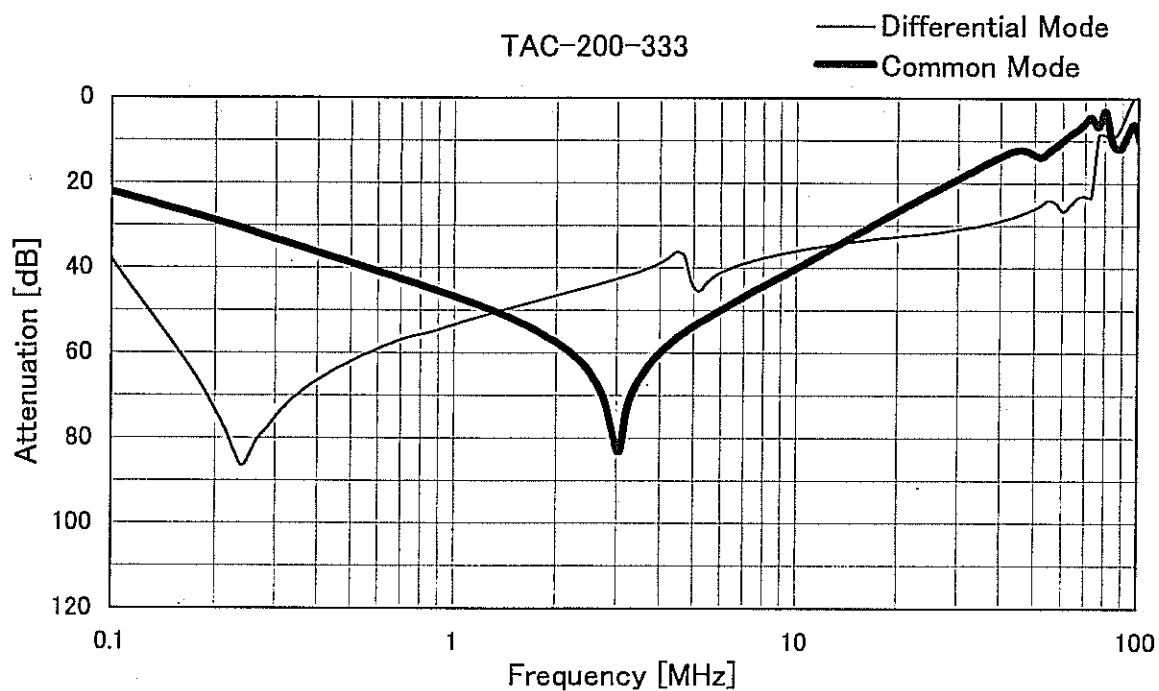



		Temperature 25°C Testing Circuitry Figure B
Model	TAC-200-□□□	
Item	Leakage Current	
Object	_____	

1.Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
TAC-200-103	UL1283	0.62	0.77	1.3	1.5	1.6	
TAC-200-223	UL1283	1.4	1.7	2.8	3.3	3.4	
TAC-200-333	UL1283	2.1	2.6	4.1	4.9	5.2	

2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

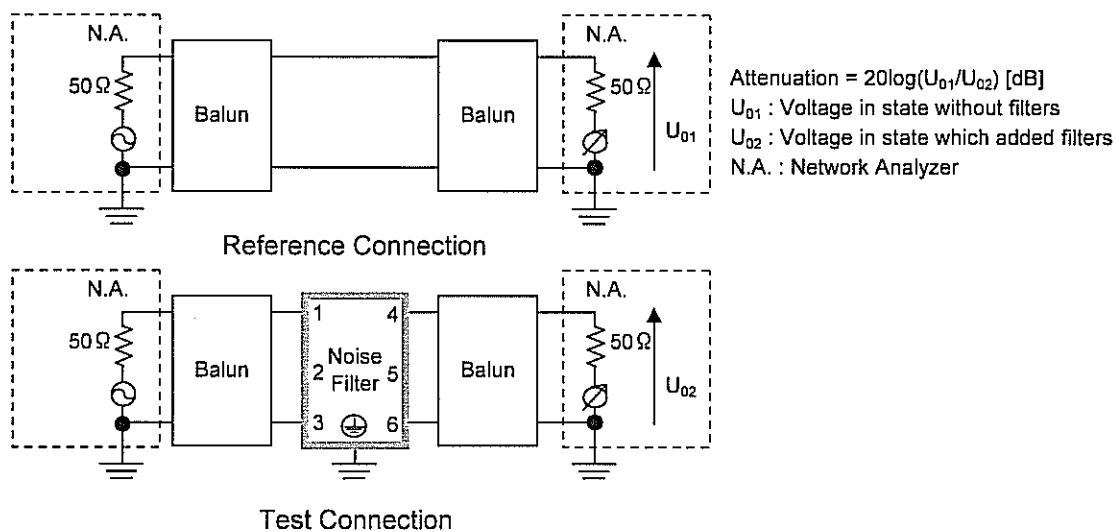


Figure A - 1 Differential mode attenuation measurement

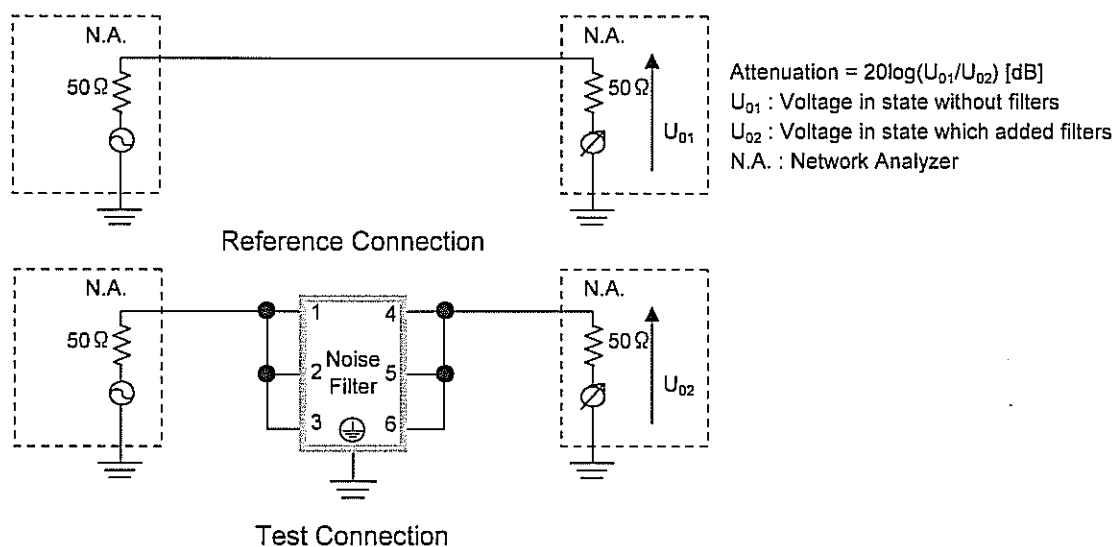


Figure A - 2 Common mode attenuation measurement

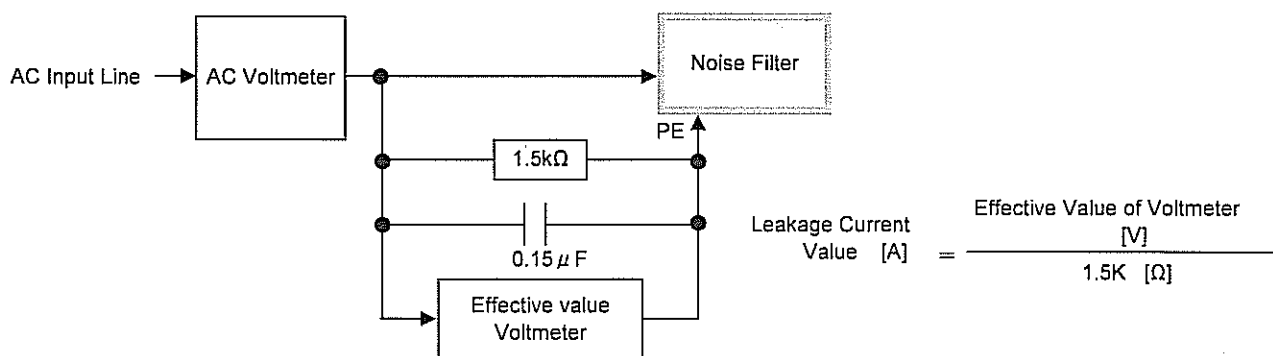


Figure B Leakage current measurement (UL1283)