

# TEST DATA OF TBC-100-□□□

Noise Filter

June. 20. 2008

Approved by : Toshio Watanabe  
Toshio Watanabe Design Manager

Prepared by : Tadayuki Noda  
Tadayuki Noda Design Engineer

**COSEL CO.,LTD.**





## CONTENTS

1. Attenuation Characteristics . . . . .	1
2. Leakage Current . . . . .	3
3. Figure of Testing Circuitry . . . . .	4

(Final Page 4)


# COSEL

Model	TBC-100-□□□	Temperature 25°C Testing Circuitry Figure A
Item	Attenuation Characteristics	
Object	_____	

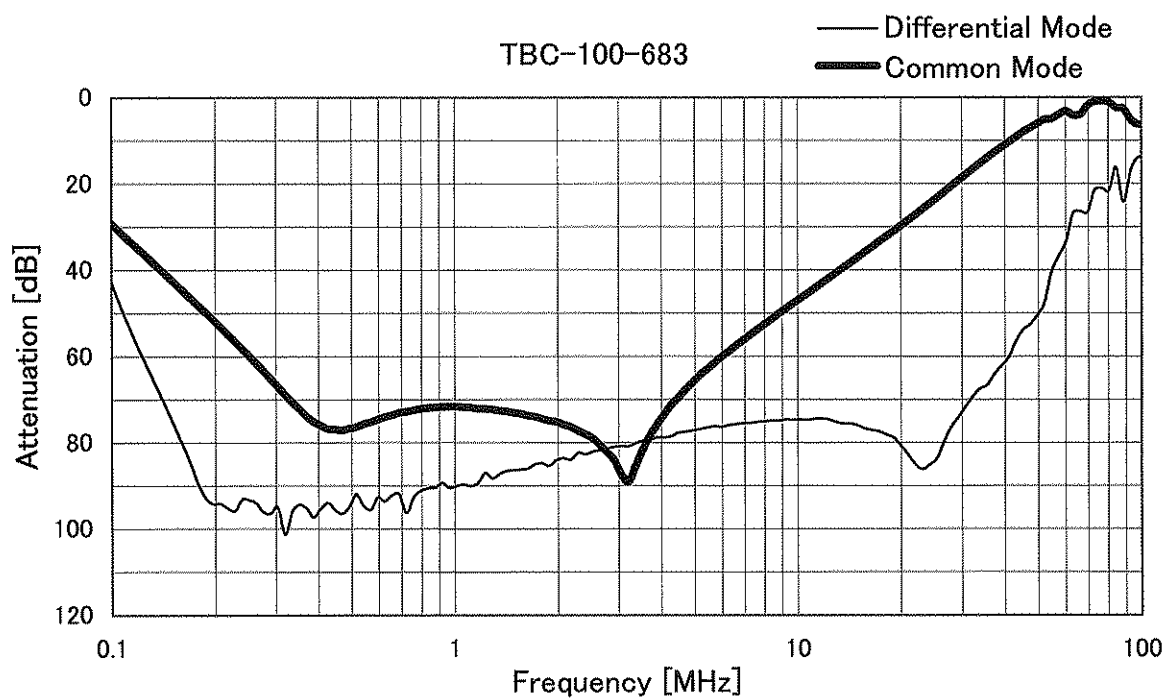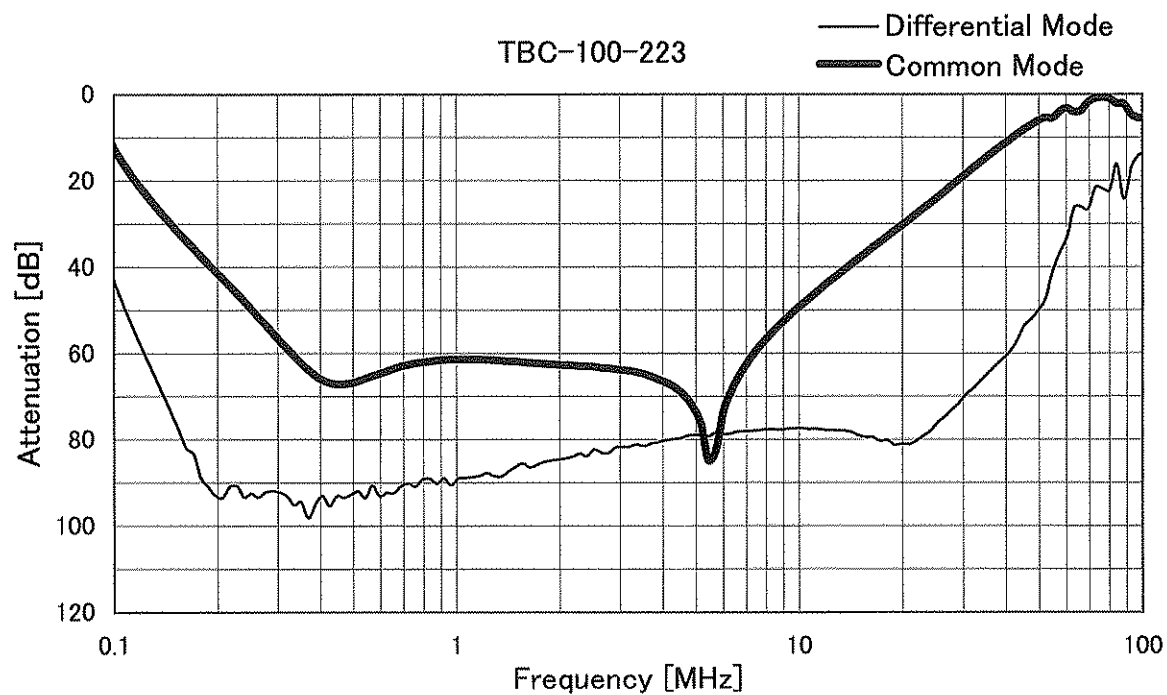

**COSEL**

Model	TBC-100-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	_____		

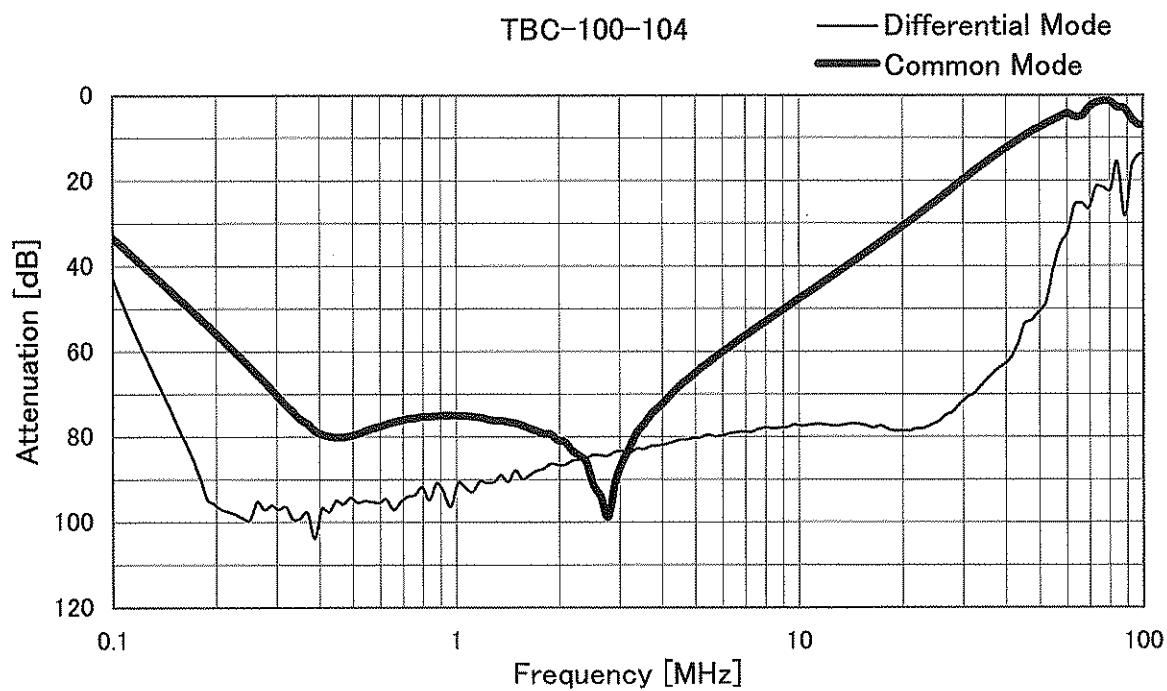



Model		TBC-100-□□□	Temperature 25°C Testing Circuitry Figure B
Item		Leakage Current	
Object		_____	

## 1.Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
TBC-100-223	UL1283	0.52	0.69	1.2	1.4	1.4	
TBC-100-683	UL1283	1.4	1.8	2.8	3.5	3.6	
TBC-100-104	UL1283	2.1	2.6	4.3	5.1	5.3	

## 2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

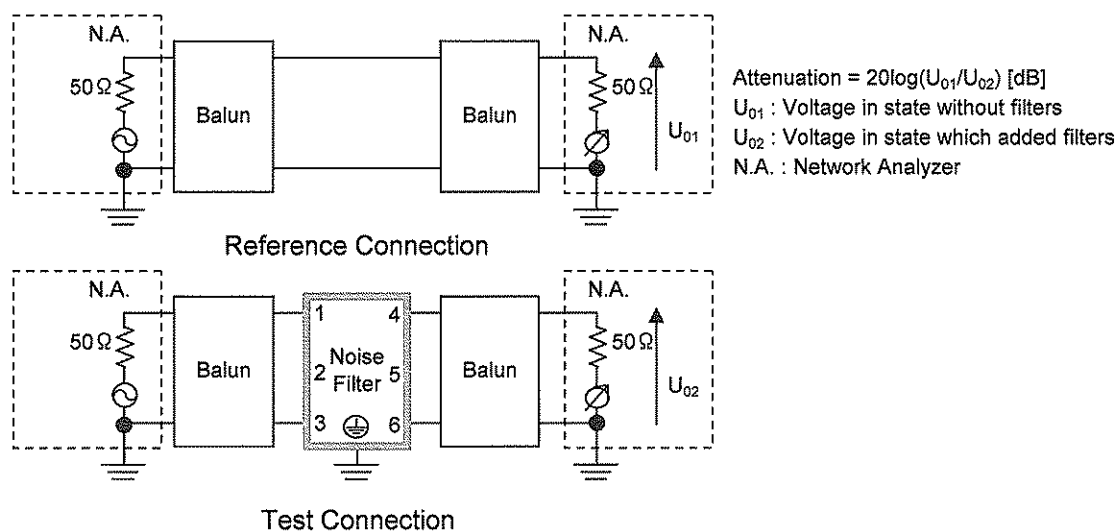


Figure A - 1 Differential mode attenuation measurement

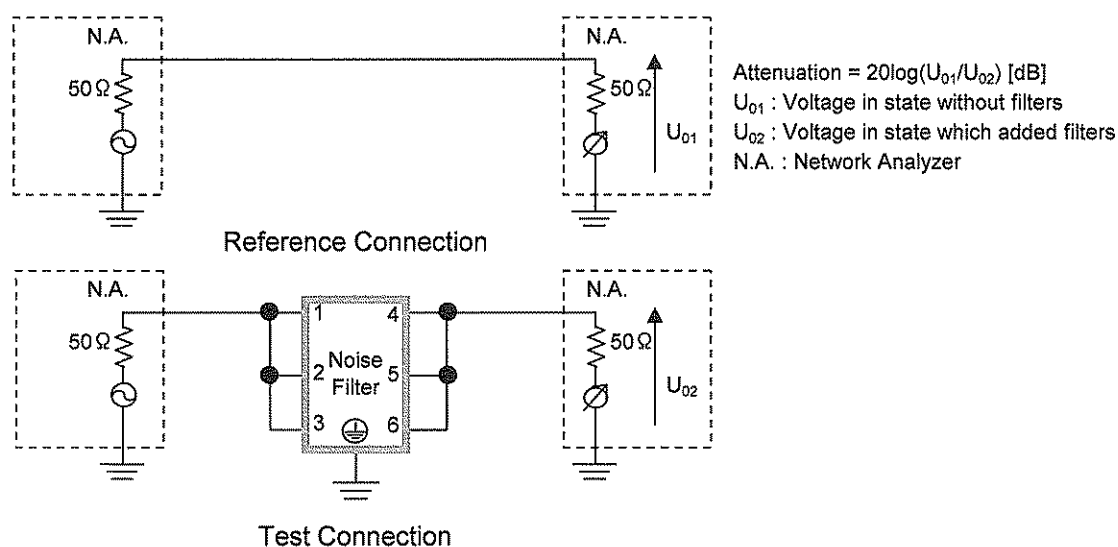


Figure A - 2 Common mode attenuation measurement

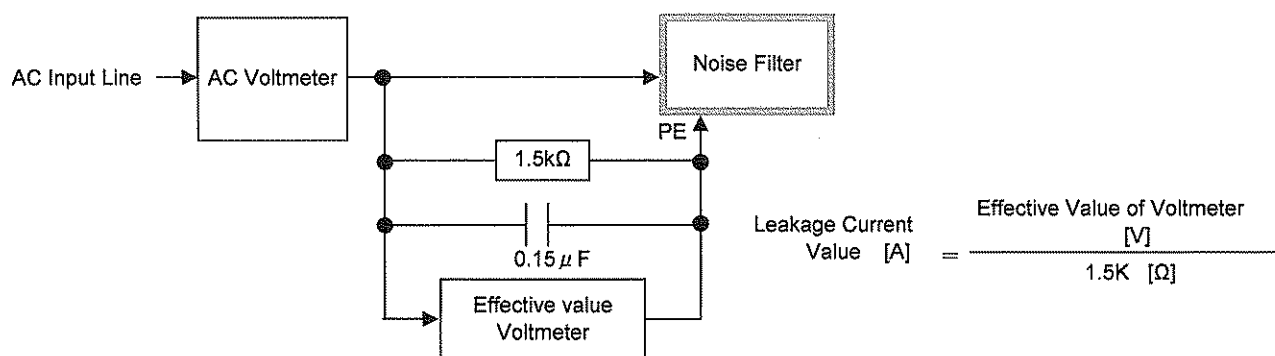


Figure B Leakage current measurement ( UL1283 )